

香港電燈有限公司  
The Hongkong Electric Co., Ltd.



**Lamma Power Station Extension  
Construction Phase  
Monthly Environmental Monitoring & Audit Report**

**May 2019**



香港電燈有限公司  
The Hongkong Electric Co., Ltd.



**ENVIRONMENTAL IMPACT ASSESSMENT (EIA) ORDINANCE, CAP. 499**

**ENVIRONMENTAL PERMIT NO. EP-071/2000/C**

**LAMMA POWER STATION EXTENSION  
ENVIRONMENTAL MONITORING & AUDIT PROGRAMME  
AT CONSTRUCTION PHASE**

Report Title	Lamma Power Station Extension – Unit L10 & L11 & L12 Monthly EM&A Report (May 2019)
Date	12 June 2019
Certified by	 (Mr. IP Tat-Yan, Environmental Team Leader)
Verified by	 Mr. Y T Tang (AECOM Asia Company Limited, Independent Environmental Checker)

## TABLE OF CONTENT

### EXECUTIVE SUMMARY

<b>1.</b>	<b>INTRODUCTION .....</b>	<b>1</b>
1.1	Background	1
1.2	Project Organisation	1
1.3	Construction Works undertaken during the Reporting Month	1
1.4	Summary of EM&A Requirements	5
<b>2.</b>	<b>AIR QUALITY .....</b>	<b>7</b>
2.1	Monitoring Requirements	7
2.2	Monitoring Locations	7
2.3	Monitoring Equipment	7
2.4	Monitoring Parameters, Frequency and Duration	7
2.5	Monitoring Procedures and Calibration Details	8
2.6	Results and Observations	9
<b>3.</b>	<b>NOISE.....</b>	<b>11</b>
3.1	Monitoring Requirements	11
3.2	Monitoring Locations	11
3.3	Monitoring Equipment	11
3.4	Monitoring Parameters, Frequency and Duration	11
3.5	Monitoring Procedures and Calibration Details	12
3.6	Results and Observations	12
<b>4.</b>	<b>ENVIRONMENTAL AUDIT .....</b>	<b>14</b>
4.1	Review of Environmental Monitoring Procedures	14
4.2	Assessment of Environmental Monitoring Results	14
4.3	Waste Management	14
4.4	Site Environmental Audit	15
4.5	Status of Environmental Licensing and Permitting	15
4.6	Implementation Status of Environmental Mitigation Measures	16
4.7	Implementation Status of Event/Action Plans	16
4.8	Implementation Status of Environmental Complaint Handling Procedures	16
<b>5.</b>	<b>FUTURE KEY ISSUES .....</b>	<b>17</b>
5.1	Key Issues for the Coming Month	17
5.2	Monitoring Schedules for the Next 3 Months	18
5.3	Construction Program for the Next 3 Months	18
<b>6.</b>	<b>CONCLUSION .....</b>	<b>19</b>

## **LIST OF TABLES**

Table 1.1	Construction Activities and Their Corresponding Environmental Mitigation Measures
Table 2.1	Air Quality Monitoring Locations
Table 2.2	Air Quality Monitoring Equipment
Table 2.3	Air Quality Monitoring Parameter, Duration and Frequency
Table 3.1	Noise Monitoring Equipment
Table 3.2	Noise Monitoring Duration and Parameter
Table 4.1	Summary of AL Level Exceedances on Monitoring Parameters
Table 4.2	Estimated Amounts of Waste in May 2019
Table 4.3	Summary of Environmental Licensing and Permit Status
Table 4.4	Environmental Complaints Received in May 2019
Table 4.5	Outstanding Environmental Complaints Carried Over

## **LIST OF FIGURES**

Figure 1.1	Layout of Work Site
Figure 2.1	Location of Air Quality Monitoring Stations
Figure 3.1	Location of Noise Monitoring Stations

## **APPENDICES**

Appendix A	Organization Chart
Appendix B	Action and Limit Levels for Air Quality and Noise
Appendix C	Environmental Monitoring Schedule
Appendix D	Air Quality Monitoring Results for May 2019
Appendix E	Noise Monitoring Results for May 2019
Appendix F	The QA/QC Procedures and Results
Appendix G	Event/Action Plans
Appendix H	Site Audit Summary
Appendix I	Summary of EMIS
Appendix J	Tentative Construction Programme
Appendix K	Monthly Waste Flow Table for May 2019

## EXECUTIVE SUMMARY

This is the 109<sup>th</sup> monthly Environmental Monitoring and Audit (EM&A) report for the Project “Construction of Lamma Power Station Extension” prepared by the Environmental Team (ET). This report presents the results of impact monitoring on air quality and noise for the said project in May 2019.

The reclamation and submarine pipeline works were completed with the first gas-fired combined cycle unit (viz. Unit L9) commissioned in October 2006, working currently on base load operation. To cope with the scheduled retirement of the existing units at Lamma Power Station, the second gas-fired combined cycle unit (viz. Unit L10) is planned for commercial operation in early 2020 and the associated construction work commenced in February 2016.

In September 2016, the Government approved HK Electric to construct the third combined cycle gas-fired generating unit (L11) to implement the 2020 Fuel Mix Target. L11 is planned for commercial operation in 2022 and the associated construction work commenced in November 2016.

With the Government’s approval to build the fourth combined cycle gas-fired generating unit (L12) in July 2018, the associated construction work commenced in April 2019. When L12 is commissioned in 2023, the total gas-fired electricity generation will further rise to reach about 70% of our total output.

Air and noise monitoring were performed. The results were checked against the established Action/Limit (AL) levels. An on-site audit was conducted once per week. The implementation status of the environmental mitigation measures, Event/Action Plan and environmental complaint handling procedures were also checked.

### Construction Activities Undertaken

Construction activities for Lamma Extension during the reporting month are tabulated as follows:

Item	Construction Activities
Unit L10 Civil and Building Works	Main Station Building, Urea Plant and Store Area (trench excavation and backfilling, formwork, steel fixing and concreting), and cable trench
Unit L10 Mechanical Erection	Condenser installation, HRSG installation and turbine block installation
Unit L10 Electrical, Instrumentation & Control Erection	Cable installation
Unit L11 Civil and Building Works	275kV Station Building Extension Works, Main Building Station and CW pipe excavation
Unit L12 Foundation Works	Bored Pile Work and Pre-drilling Work

### Environmental Monitoring Works

All monitoring work at designated stations was performed as scheduled satisfactorily.

#### *Air Quality*

No exceedance of Action/Limit levels on 1-hour TSP and 24-hour TSP for air quality was recorded in the month.

#### *Noise*

Construction work for Lamma Extension was carried out during the restricted hours including evening-time, holidays and night-time under valid Construction Noise Permit. No exceedance of Action and Limit levels for noise arising from the construction of Lamma Extension was recorded in the month.

#### **Site Environmental Audit**

Site audits were carried out on a weekly basis to monitor environmental issues on the construction site. The site conditions were generally satisfactory.

#### Environmental Licensing and Permitting

Description	Permit No.	Valid Period		Issued To	Date of Issuance
		From	To		
Varied Environmental Permit	EP-071/2000/C	18/05/05	-	HK Electric	18/05/05
Construction Noise Permit	GW-RS1173-18	01/01/19	30/06/19	Contractor	14/12/18
Construction Noise Permit	GW-RS0210-19	18/03/19	14/09/19	Contractor	14/03/19
Construction Noise Permit	GW-RS0383-19	06/05/19	01/11/19	Contractor	02/05/19
WPCO Discharge Licence	WT00027316-2017	01/03/17	31/03/22	Contractor	01/03/17
Registration of Chemical Waste Producer	WPN5213-912-P2781-22	22/02/16	-	Contractor	22/02/16
Waste Disposal Billing Account	Account No.: 7026035	06/10/16	-	Contractor	06/12/16
Waste Disposal Billing Account	Account No.: 7026793	28/12/16	-	Contractor	28/12/16
Waste Disposal Billing Account	Account No.: 7027632	20/04/17	-	Contractor	20/04/17
Waste Disposal Billing Account	Account No.: 7031135	21/06/18	-	Contractor	21/06/18
Waste Disposal Billing Account	Account No.: 7033637	01/04/19	-	Contractor	01/04/19

#### **Implementation Status of Environmental Mitigation Measures**

Environmental mitigation measures for the construction activities as recommended in the EM&A manual were implemented in the reporting month.

#### **Environmental Complaints**

No complaint against the construction activities was received in the reporting month.

#### **Future Key Issues**

The future key issues to be considered in the coming month are as follows:

#### Unit L10 Civil and Building Works

- to continue monitoring the noise level during construction;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary;
- to treat wastewater in sedimentation pit and tanks before discharge and to ensure compliance with the WPCO discharge licence already obtained.

#### Unit L10 Mechanical Erection

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary;

#### Unit L10 Electrical, Instrumentation & Control Erection

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary;

#### Unit L11 Civil and Building Works

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary;
- to treat wastewater in sedimentation pit and tanks for reuse on water spraying.

#### Unit L12 Foundation Works

- to continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained;
- to continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the performance;
- to monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary;
- to treat wastewater in sedimentation pit and tanks for reuse on water spraying.

#### **Concluding Remarks**

The environmental performance of the project was generally satisfactory.

## **1. INTRODUCTION**

### **1.1 Background**

The Environmental Team (hereinafter called the “ET”) was formed within the Hongkong Electric Co. Ltd (HEC) to undertake Environmental Monitoring and Audit for “Construction of Lamma Power Station Extension” (hereinafter called the “Project”). Under the requirements of Section 6 of Environmental Permit EP-071/2000/C, an EM&A programme for impact environmental monitoring set out in the EM&A Manual (Construction Phase) is required to be implemented. In accordance with the EM&A Manual, environmental monitoring of air quality, noise and water quality and regular environmental audits are required for the Project. With the completion of reclamation and submarine pipeline works, no further marine water quality monitoring would be required.

The Project involves the construction of a gas-fired power station employing combined cycled gas turbine technology, forming an extension to the existing Lamma Power Station. The key elements of the Project including the construction activities associated with the transmission system and submarine gas pipeline are outlined as follows.

- dredging and reclamation to form approximately 22 hectares of usable area;
- construction of six 300MW class gas-fired combined cycle units;
- construction of a gas receiving station;
- construction of a transmission system linking the Lamma Extension to load centres on Hong Kong Island;
- laying of a gas pipeline for the supply of natural gas to the new power station

This report summarizes the environmental monitoring and audit work for the Project for the month of May 2019.

### **1.2 Project Organisation**

An Environmental Management Committee (EMC) has been set up in HEC to oversee the Project. The management structure includes the following:

- Environmental Protection Department (The Authority);
- Environmental Manager (The Chairman of the Environmental Management Committee);
- Engineer;
- Independent Environmental Checker (IEC);
- Environmental Team (ET);
- Contractor.

The project organisation chart for the construction EM&A programme is shown in [Appendix A](#).

### **1.3 Construction Works undertaken during the Reporting Month**

Construction activities for Unit L10 civil and building works were carried out for Main Station Building, Urea Plant and Store Area (trench excavation and backfilling, formwork, steel fixing and concreting), and for Cable Trench. Construction activities for Unit L10 mechanical erection were condenser installation, HRSG installation and turbine block installation. Construction activity for Unit L10 electrical, instrumentation & control erection was cable installation. Construction activities for Unit L11 civil and building works were, 275kV station building



extension works, Main Station Building and CW pipe excavation. Construction activities for Unit L12 foundation works were bored pile work and pre-drilling work. Layout plan for construction site is shown in [Figure 1.1](#).

The main construction activities carried out during the reporting month and the corresponding environmental mitigation measures are summarized in [Table 1.1](#). The implementation of major mitigation measures in the month is provided in [Appendix I](#).

Table 1.1 Construction Activities and Their Corresponding Environmental Mitigation Measures

Item	Construction Activities	Environmental Mitigation Measures
Unit L10 Civil and Building Works		
1.	Main Station Building, Urea Plant and Store Area (trench excavation and backfilling, formwork, steel fixing and concreting)	<p><b>Air</b></p> <ul style="list-style-type: none"> <li>- All regulated machine attached with valid exception/approval NRMM labels.</li> <li>- Water truck was used for water spraying of the haul road.</li> <li>- Water spraying for concrete breaking of pile head.</li> <li>- Excavated slope covered with cement or tarpaulin.</li> <li>- Backfilled surface was compacted.</li> <li>- Wheel washing facilities was provided.</li> <li>- Provision of shelter with three sides and top cover for fendolite mixer and fendolite stock should be covered.</li> </ul> <p><b>Noise</b></p> <ul style="list-style-type: none"> <li>- Works conducted during holiday should comply with the valid CNP.</li> </ul> <p><b>Wastewater</b></p> <ul style="list-style-type: none"> <li>- Wastewater should be treated in sedimentation pit and tanks before discharge. Solution should be added to speed up the sedimentation process. Sediment in pit and tanks must be removed regularly.</li> </ul> <p><b>Waste Management</b></p> <ul style="list-style-type: none"> <li>- Excavated soil was temporary stored for backfilling.</li> <li>- Scrape metal will be recycled.</li> <li>- Timber will be reused as much as possible.</li> </ul>

Item	Construction Activities	Environmental Mitigation Measures
2.	Cable Trench	<p><b>Air</b></p> <ul style="list-style-type: none"> <li>- All regulated machine attached with valid exception/approval NRMM labels.</li> <li>- Water spraying for road surface breaking</li> <li>- Soil stock covered with tarpaulin.</li> </ul> <p><b>Wastewater</b></p> <ul style="list-style-type: none"> <li>- Wastewater should be treated in sedimentation pit and tanks before discharge. Solution should be added to speed up the sedimentation process. Sediment in pit and tanks must be removed regularly.</li> </ul> <p><b>Waste Management</b></p> <ul style="list-style-type: none"> <li>- Excavated soil was temporary stored for backfilling.</li> <li>- Scrape metal will be recycled.</li> </ul>
Unit L10 Mechanical Erection		
3.	Condenser installation  HRSG installation  Turbine block installation	<p><b>Air</b></p> <ul style="list-style-type: none"> <li>- Dust suppression in the main haul road.</li> </ul> <p><b>Noise</b></p> <ul style="list-style-type: none"> <li>- General noise mitigation measures employed at all work sites throughout the construction phase.</li> </ul> <p><b>Waste Management</b></p> <ul style="list-style-type: none"> <li>- Waste Management Plan submitted and implemented.</li> </ul>
Unit L10 Electrical, Instrumentation & Control Erection		
4.	Cable installation	<p><b>Air</b></p> <ul style="list-style-type: none"> <li>- Dust suppression in the main haul road.</li> </ul> <p><b>Noise</b></p> <ul style="list-style-type: none"> <li>- General noise mitigation measures employed at all work sites throughout the construction phase.</li> </ul> <p><b>Waste Management</b></p> <ul style="list-style-type: none"> <li>- Waste Management Plan submitted and implemented.</li> </ul>
Unit L11 Civil and Building Works		
5.	275kV Station Building	<p><b>Air</b></p> <ul style="list-style-type: none"> <li>- All regulated machine attached with valid</li> </ul>

Item	Construction Activities	Environmental Mitigation Measures
	Extension Works	exception/approval NRMM labels.  <b>Waste Management</b> <ul style="list-style-type: none"> <li>- Scrape metal will be recycled.</li> <li>- Timber will be reused as much as possible.</li> <li>- Chemical waste should be collected by licensed collector</li> </ul>
6.	Main Station Building and CW Pipe Excavation	<b>Air</b> <ul style="list-style-type: none"> <li>- All regulated machine attached with valid exception/approval NRMM labels.</li> <li>- Water truck and water sprinkler system was used.</li> <li>- Water spraying for concrete breaking of pile head.</li> <li>- Wheel washing facility was provided.</li> </ul> <b>Wastewater</b> <ul style="list-style-type: none"> <li>- Wastewater should be treated in sedimentation tanks for reuse on water spraying.</li> </ul> <b>Waste Management</b> <ul style="list-style-type: none"> <li>- Excavated soil was temporary stored for backfilling.</li> <li>- Scrape metal will be recycled.</li> <li>- Timber will be reused as much as possible.</li> </ul>
<b>Unit L12 Foundation Works</b>		
7.	Bored Pile Work	<b>Air</b> <ul style="list-style-type: none"> <li>- Dust suppression in the main haul road.</li> <li>- Using ULSD for PMEs.</li> <li>- Cover dusty stockpile with tarpaulin and water spraying.</li> </ul> <b>Noise</b> <ul style="list-style-type: none"> <li>- General noise mitigation measure employed at all work sites throughout the construction phase.</li> </ul> <b>Wastewater</b> <ul style="list-style-type: none"> <li>- Wastewater should be pumped to the sedimentation ponds for desilting process. After that, waste water will be re-used for construction activities or pumped for storage.</li> </ul> <b>Waste Management</b> <ul style="list-style-type: none"> <li>- Waste Management Plan submitted and implemented</li> </ul>
8.	Pre-drilling Work	<b>Noise</b> <ul style="list-style-type: none"> <li>- General noise mitigation measure employed at all</li> </ul>

<b>Item</b>	<b>Construction Activities</b>	<b>Environmental Mitigation Measures</b>
		work sites throughout the construction phase.  <b>Wastewater</b> <ul style="list-style-type: none"><li>- All wastewater will be re-used for construction activities or pumped for storage.</li></ul> <b>Waste Management</b> <ul style="list-style-type: none"><li>- Waste Management Plan submitted and implemented.</li></ul>

#### 1.4 Summary of EM&A Requirements

The detailed EM&A monitoring work for air quality and noise are described in Sections 2 and 3 respectively. Regular environmental site audits for air quality, noise, water quality and waste management were carried out.

The following environmental audits are summarized in Section 4 of this report:

- Environmental monitoring results;
- Waste Management Records;
- Weekly site audit results;
- The status of environmental licensing and permits for the Project;
- The implementation status of environmental protection and pollution control/ mitigation measures.

Future key issues will be reported in Section 5 of this report.

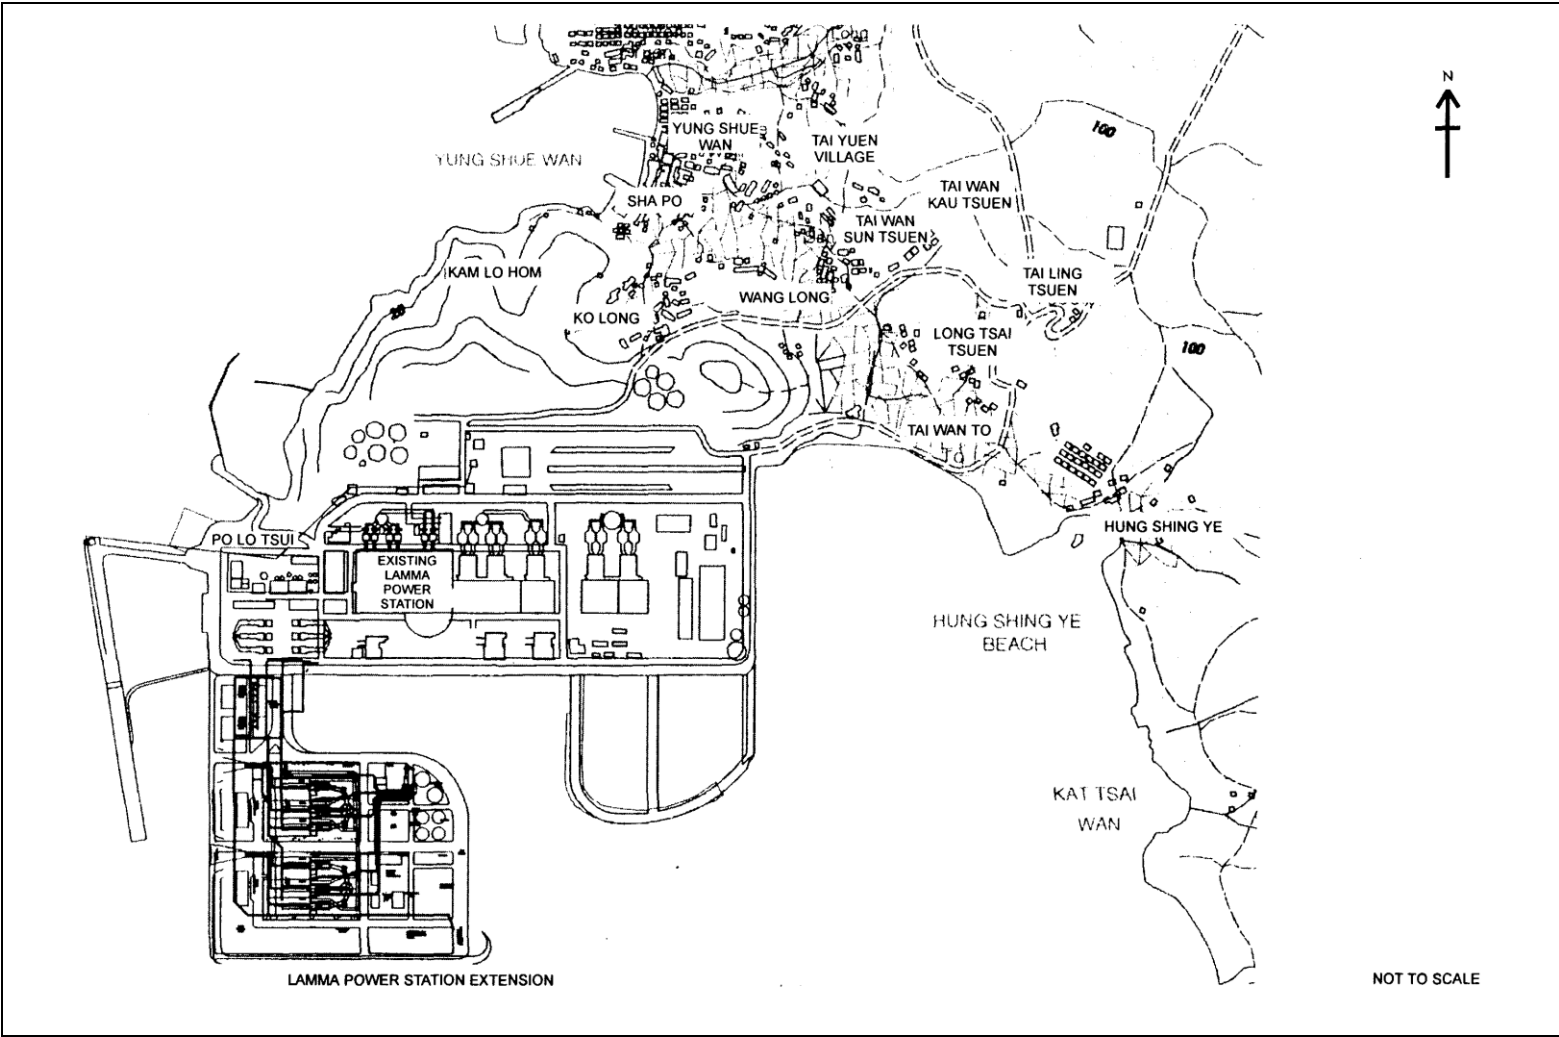


Figure 1.1 Layout of Work Site

## 2. AIR QUALITY

### 2.1 Monitoring Requirements

1-hour and 24-hour TSP monitoring at agreed frequencies were conducted to monitor air quality. The impact monitoring data were checked against the Action/Limit Levels as determined in the Baseline Monitoring Report (Construction Phase). [Appendix B](#) shows the established Action/Limit Levels for Air Quality.

### 2.2 Monitoring Locations

Three dust monitoring locations were selected for 1-hour TSP sampling (AM1, AM2 & AM3) while four monitoring locations were selected for 24-hour TSP sampling (AM1, AM2, AM3 and AM4). [Table 2.1](#) tabulates the monitoring stations. The locations of the monitoring stations are shown in [Figure 2.1](#).

Table 2.1 Air Quality Monitoring Locations

Location I.D.	Description
AM1	Reservoir
AM2	East Gate
AM3	Ash Lagoon
AM4	Tai Yuen Village

### 2.3 Monitoring Equipment

It is agreed with EPD that continuous 24-hour TSP air quality monitoring would be performed using TEOM continuous dust monitor and the MINIVOL Portable Sampler at AM1,2&3 and AM4 respectively. TEOM continuous dust monitors were used to carry out 1-hour TSP monitoring at AM1, AM2 and AM3. [Table 2.2](#) summarises the equipment used in dust monitoring.

Table 2.2 Air Quality Monitoring Equipment

Equipment	Model and Make
<i>24-hour sampling:</i>	
Continuous TSP Dust Meter	TEOM continuous dust monitor Thermo Scientific
MINIVOL Portable Sampler	AIRMETRICS
<i>1-hour sampling:</i>	
Continuous TSP Dust Meter	TEOM continuous dust monitor Thermo Scientific

### 2.4 Monitoring Parameters, Frequency and Duration

[Table 2.3](#) summarises the monitoring parameters, duration and frequency of air quality monitoring. The monitoring schedule for the reporting month is shown in [Appendix C](#).

Table 2.3 Air Quality Monitoring Parameter, Duration and Frequency

Monitoring Stations	Parameter	Duration	Frequency
AM1	1-hour TSP	1	3 hourly samples every 6 days
	24-hour TSP	24	Once every 6 days
AM2	1-hour TSP	1	3 hourly samples every 6 days
	24-hour TSP	24	Once every 6 days
AM3	1-hour TSP	1	3 hourly samples every 6 days
	24-hour TSP	24	Once every 6 days
AM4	24-hour TSP	24	Once every 6 days

## 2.5 Monitoring Procedures and Calibration Details

MINIVOL (24- hour TSP Monitoring):

### *Preparation of Filter Papers*

- Visual inspection of filter papers was carried out to ensure that there were no pinholes, tears and creases;
- The filter papers were then labeled before sampling.
- The filter papers were equilibrated at room temperature and relative humidity < 50% for at least 24 hours before weighing.

### *Field Monitoring*

- During collection of the sampled filter paper, the information on the elapse timer was logged. Site observations around the monitoring stations, which might have affected the monitoring results, were also recorded. Major pollution sources, if any, would be identified and reported.
- The post-sampling filter papers were removed carefully from the filter holder and folded to avoid loss of fibres or dust particles from the filter papers;
- The filter holder and its surrounding were cleaned;
- A pre-weighed blank filter paper for the next sampling was put in place and aligned carefully. The filter holder was then tightened firmly to avoid leakage;
- The programmable timer was set for the next 24 hrs sampling period;
- The post-sampling filter papers were equilibrated at room temperature and relative humidity < 50% for at least 24 hours before weighing.

TEOM continuous dust monitor (24- hour TSP and 1- hour TSP Monitoring):

- The following parameters of the TEOM model dust meters are regularly checked to ensure proper functionality:
  - Operation Mode;
  - Frequency of the tapered element;
  - Main flow;
  - Bypass flow.

### *Maintenance & Calibration*

- The monitoring equipment and their accessories are maintained in good working conditions.

- Monitoring equipment is calibrated at monthly intervals. Calibration details are shown in [Appendix F](#).

## 2.6 Results and Observations

All dust monitoring works were conducted on schedule. All monitoring data and graphical presentation of the monitoring results are provided in [Appendix D](#). Key findings and observations are provided below:

### *1-hour TSP*

No exceedance of 1-hour TSP Action/Limit Level was recorded in the month.

### *24-hour TSP*

No exceedance of 24-hour TSP Action/Limit Level was recorded in the month.



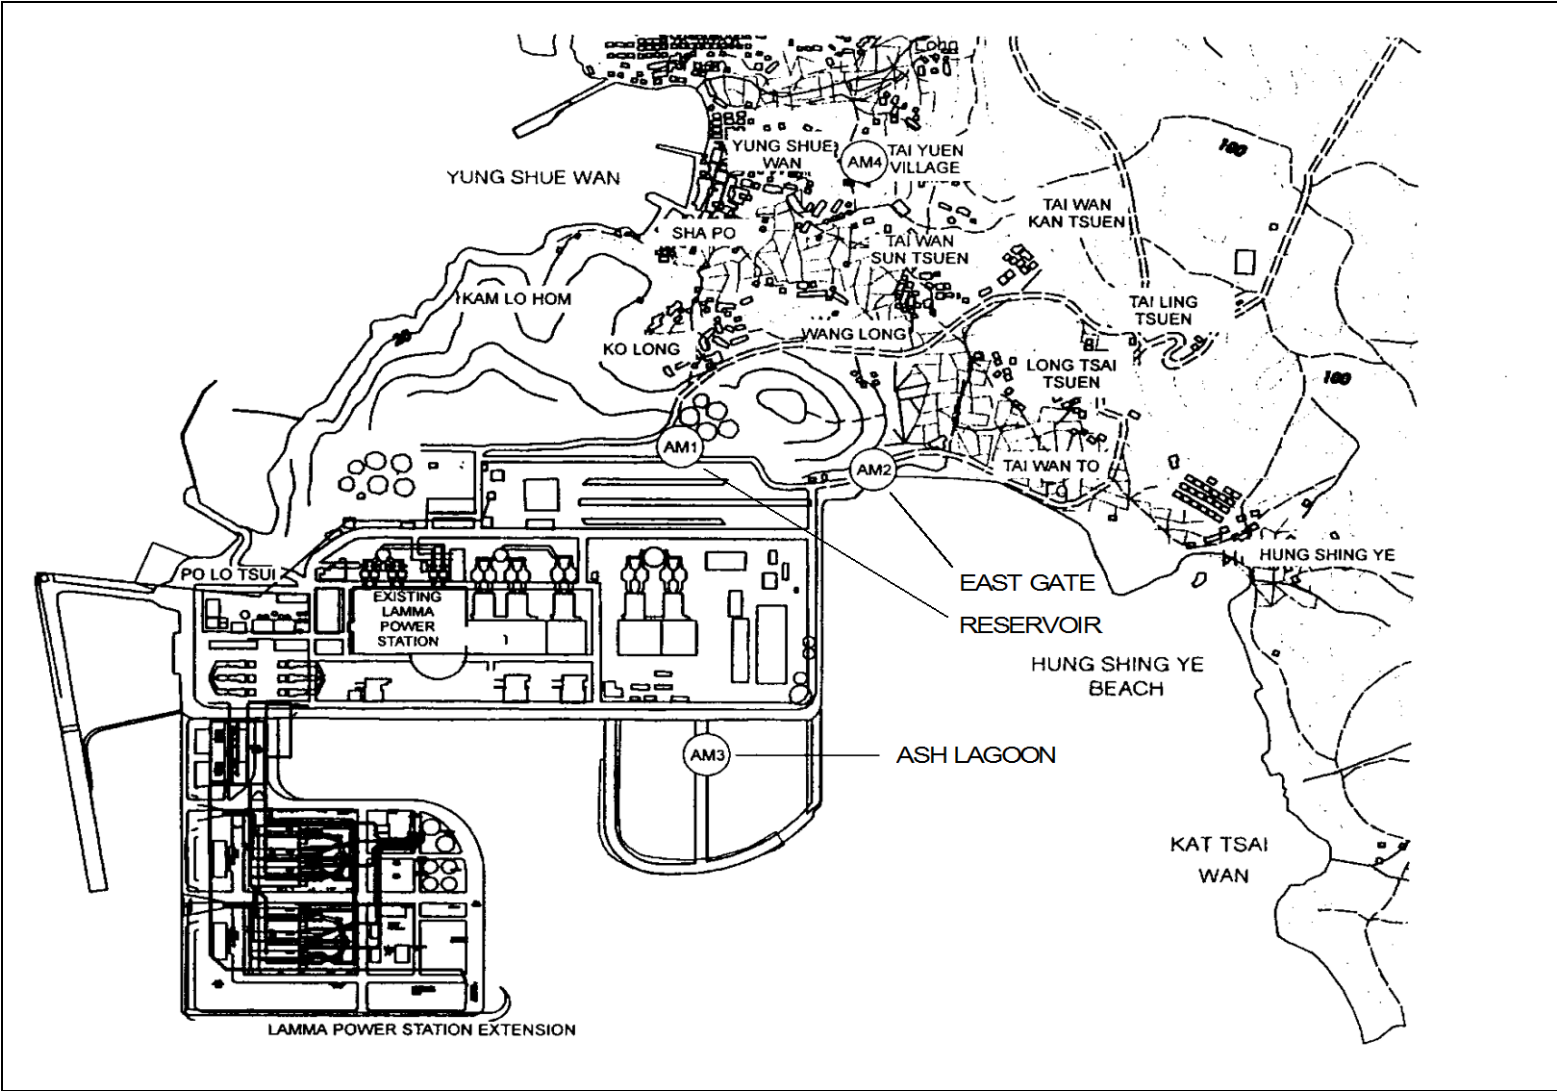


Figure 2.1 Location of Air Quality Monitoring Stations

### 3. NOISE

#### 3.1 Monitoring Requirements

Continuous noise alarm monitoring at Ash Lagoon/Ching Lam were carried out to calculate the noise contributed by the construction activities at the two critical NSR's, viz. Long Tsai Tsuen/Hung Shing Ye and the school within the village of Tai Wan San Tsuen. The impact monitoring data for construction noise were checked against the limit levels specified in the EM&A Manual. With the availability of the construction noise permits, impact monitoring for the construction work during the restricted hours was also carried out. Section 3 presents the details of the construction noise permits.

The impact noise monitoring data were checked against the limit levels specified in the EM&A Manual. [Appendix B](#) shows the established Action/Limit Levels for noise.

#### 3.2 Monitoring Locations

In accordance with the EM&A manual, the identified noise monitoring locations of Ash Lagoon and Ching Lam are shown in [Figure 3.1](#).

#### 3.3 Monitoring Equipment

The sound level meters used for noise monitoring complied with International Electrotechnical Commission Publications 651:1979 (Type 1) and 804:1985 (Type 1). The noise monitoring equipment used is shown in [Table 3.1](#).

Table 3.1 Noise Monitoring Equipment

Equipment	Model
Sound level meters	B&K 2250
Sound level calibrator	B&K 4231

#### 3.4 Monitoring Parameters, Frequency and Duration

Continuous alarm monitoring was carried out at Ash Lagoon and Ching Lam. The measurement duration and parameter of noise monitoring were presented in [Table 3.2](#) as follows:

Table 3.2 Noise Monitoring Duration and Parameter

Location	Time Period	Frequency	Parameter
----------	-------------	-----------	-----------

Ash Lagoon	Day-time: 0700-1900 hrs on normal weekdays	Day-time: 30 minutes	30-min $L_{Aeq}$
	Evening-time & holidays: 0700-2300 hrs on holidays; and 1900-2300 hrs on all other days	Evening-time & holidays: 5 minutes	5-min $L_{Aeq}$
Ching Lam	Night-time: 2300-0700 hrs of next day	Night-time: 5 minutes	5-min $L_{Aeq}$

### 3.5 Monitoring Procedures and Calibration Details

#### *Monitoring Procedures*

##### *Continuous Noise Monitoring for Lamma Extension Construction*

The measured noise levels (MNL's) were collected at the noise alarm monitoring stations at Ash Lagoon and Ching Lam. The notional background noise levels (viz. baseline noise data at Ash Lagoon and Ching Lam) were applied to correct the corresponding MNL's in 30-min/5-min  $L_{Aeq}$ .

A wind speed sensor was installed at Station Building Rooftop. The wind speed signal was used to determine whether the data from Ash Lagoon and Ching Lam noise alarm monitoring stations were affected. The instantaneous data was discarded in case the instantaneous wind speed exceeded 10 m/s. The 30-min/5-min  $L_{Aeq}$  was considered valid only if the amount of valid data was equal to or above 70%.

#### *Equipment Calibration*

The sound level meters and calibrators were verified by the manufacturer or accredited laboratory. With the endorsement of the Independent Environmental Checker, the enhancement of calibration of sound level meter at the noise monitoring stations was implemented. The monthly manual on-site calibration using sound level calibrator was replaced by the daily auto charge injection calibration function of the sound level meter. For additional quality assurance, manual on-site calibration would still be conducted for the noise monitoring stations once every 6 months. The manual on-site calibrations for Ash Lagoon and Ching Lam noise monitoring stations were scheduled in July and September 2019 respectively.

### 3.6 Results and Observations

Continuous noise monitoring was conducted at the two monitoring stations at Ash Lagoon and Ching Lam.

All monitoring results and their graphical presentations are provided in [Appendix E](#). No exceedance of noise Action/Limit Level was recorded in the month.

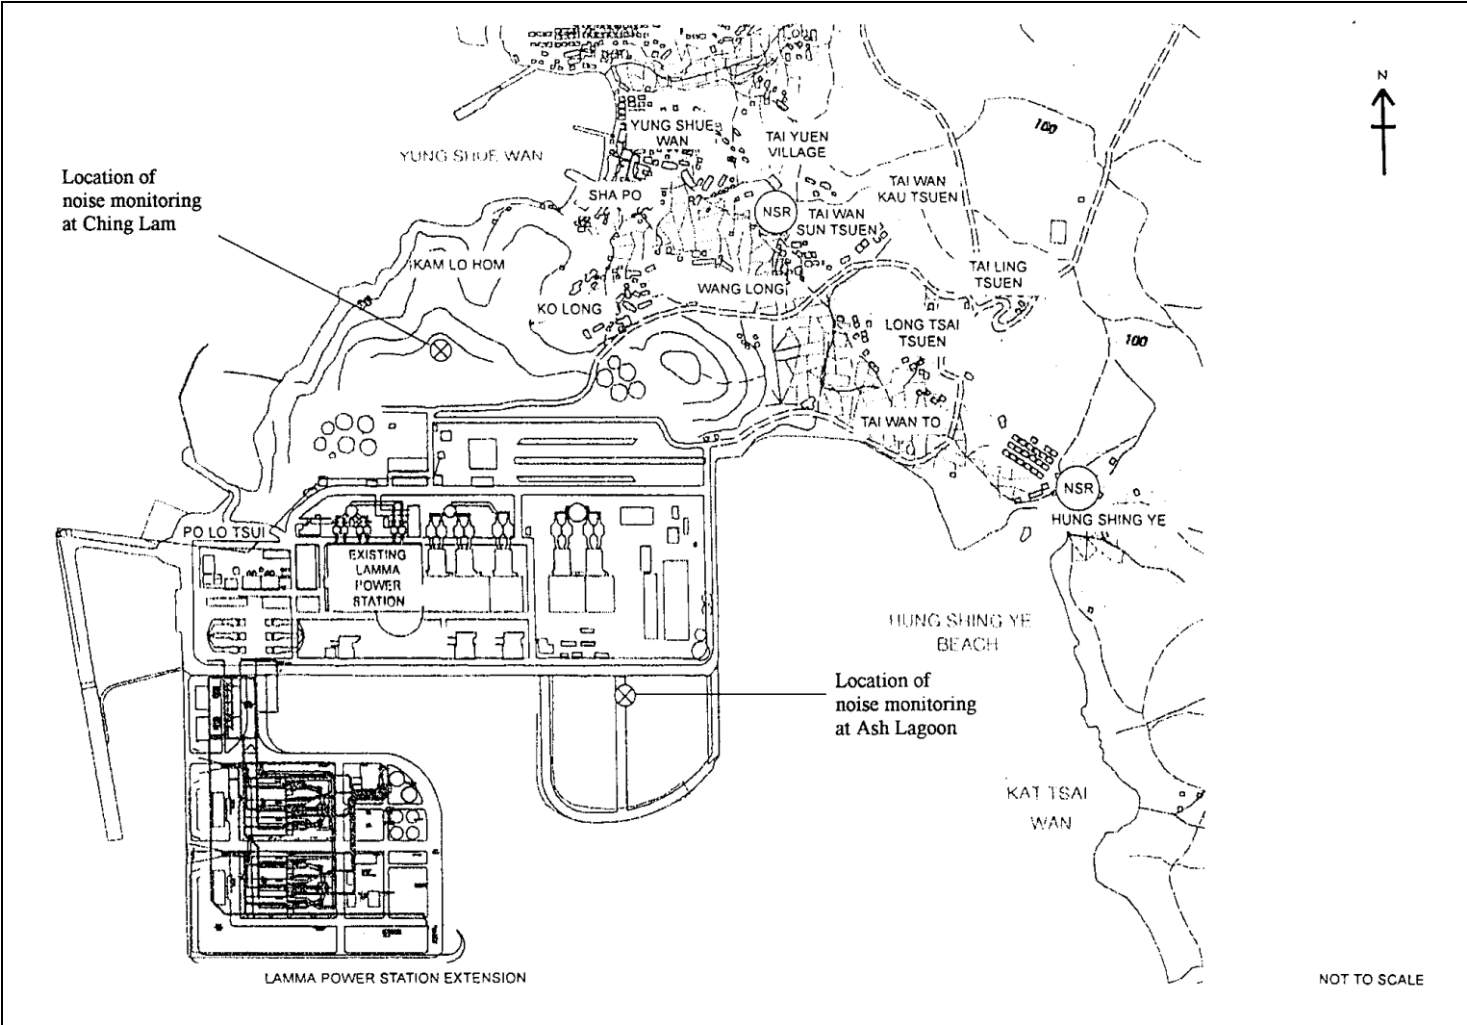


Figure 3.1 Location of Noise Monitoring Stations

## 4. ENVIRONMENTAL AUDIT

### 4.1 Review of Environmental Monitoring Procedures

The environmental monitoring procedures were regularly reviewed by the Environmental Team. No modification to the existing monitoring procedures was recommended.

### 4.2 Assessment of Environmental Monitoring Results

#### *Monitoring results for Air Quality and Noise*

The environmental monitoring results for Air Quality and Noise in the reporting month presented in Sections 2 and 3 respectively are summarized in [Table 4.1](#).

Table 4.1 Summary of AL Level Exceedances on Monitoring Parameters

Item	Parameter Monitored	Monitoring Period	No. of Exceedances In		Event/Action Plan Implementation Status and Results
			Action Level	Limit Level	
Air					
1	Ambient TSP (24-hour)	01/05/19-31/05/19	0	0	
2	Ambient TSP (1-hour)	01/05/19-31/05/19	0	0	
Noise					
1	Noise level at the critical NSR's predicted by the noise alarm monitoring system	01/05/19-31/05/19	0	0	

### 4.3 Waste Management

Wastes generated from this Project include inert construction and demolition (C&D) materials and non-inert C&D materials. Inert C&D materials comprise excavated materials and broken concrete. Non-inert C&D materials comprise general refuse, metals and paper/ cardboard packaging, plastics, chemical waste, etc.

Inert C&D material and non-inert C&D material disposed of in May 2019 are shown in [Table 4.2](#).

Table 4.2 Estimated Amounts of Waste in May 2019

Total Inert C&D Waste Materials	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste

7417.96 Tonnes	3.63 Tonnes	71.99 Tonnes	0 Litres
----------------	-------------	--------------	----------

The monthly waste flow tables prepared by the contractors are attached in [Appendix K](#)

#### 4.4 Site Environmental Audit

Site audits were carried out by ET on a weekly basis to monitor environmental issues at the construction sites to ensure that all mitigation measures were implemented timely and properly. The site audit findings for the reporting month are summarized in [Appendix H](#). The site conditions were generally satisfactory. All required mitigation measures were implemented.

#### 4.5 Status of Environmental Licensing and Permitting

All permits/licenses obtained for the project are summarised in [Table 4.3](#).

Table 4.3 Summary of Environmental Licensing and Permit Status

Description	Permit No.	Valid Period		Highlights	Status
		From	To		
Varied Environmental Permit	EP-071/2000/C	18/05/05	-	The whole construction work site	Valid
Construction Noise Permit	GW-RS1173-18	01/01/19	30/06/19	Power Block Facilities works for Unit L10. Operation of PME during restricted hours	Valid
Construction Noise Permit	GW-RS0210-19	18/03/19	14/09/19	Civil and Building Works for Unit L11. Operation of PME during restricted hours	Valid
Construction Noise Permit	GW-RS0383-19	06/05/19	01/11/19	Foundation work for Unit L12. Operation of PME during restricted hours.	Valid
WPCO Discharge Licence#	WT00027316-2017	01/03/17	31/03/22	Civil and Building Works for Unit L10	Valid
Registration of Chemical Waste Producer	WPN5213-912-P2781-22	22/02/16	-	Civil and Building Works for Unit L10	Valid
Waste Disposal Billing Account	Account No.: 7026035	06/10/16	-	Civil and Building Works for Unit L10	Valid
Waste Disposal Billing Account	Account No.: 7026793	28/12/16	-	Foundation works for Unit L11	Valid

Description	Permit No.	Valid Period		Highlights	Status
		From	To		
Waste Disposal Billing Account	Account No.: 7027632	20/04/17	-	E&M Erection of Power Block Facilities	Valid
Waste Disposal Billing Account	Account No.: 7031135	21/06/18	-	Civil and Building Works for Unit L11	Valid
Waste Disposal Billing Account	Account No.: 7033637	01/04/19	-	Foundation works for Unit L12	Valid

Notes: # - Water quality monitoring was carried out in May 2019 and the result of which had been reported under a separate cover by the contractor.

#### 4.6 Implementation Status of Environmental Mitigation Measures

Mitigation measures detailed in the permits and the EM&A Manual (Construction Phase) are required to be implemented. An updated summary of the Environmental Mitigation Implementation Schedule (EMIS) is presented in [Appendix I](#).

#### 4.7 Implementation Status of Event/Action Plans

The Event/Action Plans extracted from the EM&A Manual (Construction Phase) are presented in [Appendix G](#).

#### 4.8 Implementation Status of Environmental Complaint Handling Procedures

In May 2019, no complaint against the construction activities was received.

Table 4.4 Environmental Complaints Received in May 2019

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions /Actions Taken	Conclusion / Status
Nil	N/A	N/A

Table 4.5 Outstanding Environmental Complaints Carried Over

Case Reference / Date, Time Received / Date, Time Concerned	Descriptions /Actions Taken	Conclusion / Status
Nil	N/A	N/A

## 5. FUTURE KEY ISSUES

### 5.1 Key Issues for the Coming Month

Key issues to be considered in the coming month include:

#### Unit L10 Civil and Building Works

##### *Noise Impact*

- To continue monitoring the noise level during construction.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the noise performance.

##### *Air Impact*

- To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

##### *Water Impact*

- To treat wastewater in sedimentation pit and tanks before discharge and to ensure compliance in accordance with the WPCO discharge licence already obtained.

#### Unit L10 Mechanical Erection

##### Noise Impact

- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the noise performance.

##### Air Impact

- To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

#### Unit L10 Electrical, Instrumentation & Control Erection

##### Noise Impact

- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the noise performance.

##### Air Impact

- To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

#### Unit L11 Civil and Building Works

##### *Noise Impact*



- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the noise performance.

*Air Impact*

- To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

*Water Impact*

- To treat wastewater in sedimentation pit and tanks for reuse on water spraying.

Unit L12 Foundation Works

*Noise Impact*

- To continue monitoring the noise level during construction and to ensure compliance with the CNP's already obtained.
- To continue executing the preventive measures for avoiding noise exceedance and keep monitoring/ reviewing the noise performance.

*Air Impact*

- To monitor and review the sufficiency of the dust suppression measures provided and increase the resources accordingly if necessary.

*Water Impact*

- To treat wastewater in sedimentation pit and tanks for reuse on water spraying.

## **5.2 Monitoring Schedules for the Next 3 Months**

The tentative environmental monitoring schedules for the next 3 months are shown in [Appendix C](#).

## **5.3 Construction Program for the Next 3 Months**

The tentative construction programs for the next 3 months are shown in [Appendix J](#).

## **6. CONCLUSION**

All monitoring work at designated stations was performed as scheduled satisfactorily. The environmental monitoring works and site inspection were performed as scheduled in the reporting month. All monitoring results were checked and reviewed.

No Action/Limit level exceedance on 1-hour and 24-hour TSP level was recorded in the reporting month.

No Action/Limit level exceedance on noise was recorded in the reporting month.

Environmental mitigation measures recommended in the EM&A manual for the construction activities were implemented in the reporting month. No complaint against the construction activities was received in the reporting month. No prosecution was received for this Project in the reporting period.

The environmental performance of the Project was generally satisfactory.

Appendix A Organization Chart

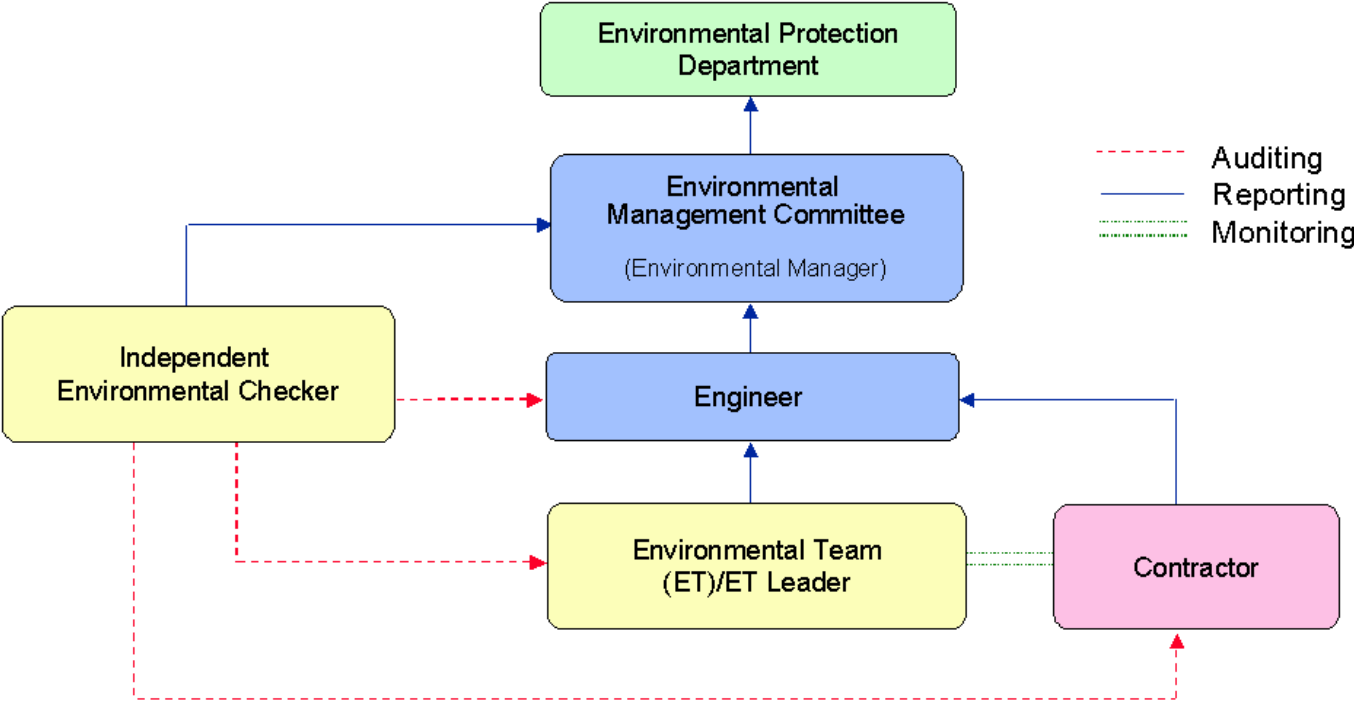


Figure A.1 Organisation of EM&A Programme at Construction Phase

## Appendix B Action and Limit Levels for Air Quality and Noise Monitoring

### B.1. Air

Table B.1 Action and Limit Levels for 1-hour and 24-hour TSP

	Action Level, $\mu\text{g}/\text{m}^3$	Limit Level, $\mu\text{g}/\text{m}^3$
1-hour TSP*	340	500
24-hour TSP	190	260

\* No Action/Limit Level for 1-hour TSP is applied to AM4 where no real time dust monitor is installed.

### B.2. Noise

Table B.2 AL Levels for Construction Noise (Other than Percussive Piling)

Parameters	Action	Limit
Noise Levels at the NSR's at Long Tsai Tsuen/Hung Shing Ye and school within the village of Tai Wan San Tsuen predicted by the noise alarm monitoring system	When one or more documented complaints are received	a. 75 dB(A) in $L_{Aeq,30 \text{ min}}$ (07:00-19:00 hrs on normal weekdays) (Note 1)
Manual noise monitoring at the nearest Pak Kok Tsui residences to cable landing points N4 and N5		b. subject to statutory control under the Noise Control Ordinance (07:00-23:00 hrs on holidays and 19:00-23:00 hrs on all other days). Set to 60 dB(A) in $L_{Aeq,5 \text{ min}}$ c. subject to statutory control under the Noise Control Ordinance (23:00-07:00 hrs of next day). Set to 45 dB(A) in $L_{Aeq,5 \text{ min}}$
Note: 1. For educational institution, the limit level shall be 70 dB(A), reduced to 65 dB(A) during examination periods.		

## Appendix C Environmental Monitoring Schedule

Table C.1 Monitoring schedule for 24hr and 1hr TSP monitoring for Lamma Extension Construction (May 2019 to August 2019)

24hr TSP Monitoring	1hr TSP Monitoring
06/May/2019	06/May/2019 1500hr to 1800hr
12/May/2019	12/May/2019 1500hr to 1800hr
18/May/2019	18/May/2019 1500hr to 1800hr
24/May/2019	24/May/2019 1500hr to 1800hr
30/May/2019	30/May/2019 1500hr to 1800hr
5/June/2019	5/June/2019 1500hr to 1800hr
11/June/2019	11/June/2019 1500hr to 1800hr
17/June/2019	17/June/2019 1500hr to 1800hr
23/June/2019	23/June/2019 1500hr to 1800hr
29/June/2019	29/June/2019 1500hr to 1800hr
5/July/2019	5/July/2019 1500hr to 1800hr
11/July/2019	11/July/2019 1500hr to 1800hr
17/July/2019	17/July/2019 1500hr to 1800hr
23/July/2019	23/July/2019 1500hr to 1800hr
29/July/2019	29/July/2019 1500hr to 1800hr
4/August/2019	4/August/2019 1500hr to 1800hr
10/August/2019	10/August/2019 1500hr to 1800hr
16/August/2019	16/August/2019 1500hr to 1800hr
22/August/2019	22/August/2019 1500hr to 1800hr
28/August/2019	28/August/2019 1500hr to 1800hr

## APPENDIX D AIR QUALITY MONITORING RESULTS

Site: Lamma Power Station Extension

Month: May 2019

24 hour TSP Measurement:-

Date	TSP concentration ( $\mu\text{g}/\text{m}^3$ )				Weather Information (From Hong Kong Observatory)		
	Reservoir (AM1)	East Gate (AM2)	Ash Lagoon (AM3)	Tai Yuen Village (AM4)	Mean Wind Speed (km/hr)	Prevailing Wind Dir. ( $^{\circ}$ )	Mean R.H. (%)
6/5/2019	6	10	9	26	42.0	060	90
12/5/2019	32	32	30	19	22.1	050	80
18/5/2019	40	43	32	50	26.9	230	80
24/5/2019	45	41	33	36	37.6	080	92
30/5/2019	34	37	30	46	37.3	070	89

1 hour TSP Measurement:-

Date	Time	TSP concentration ( $\mu\text{g}/\text{m}^3$ )		
		Reservoir (AM1)	East Gate (AM2)	Ash Lagoon (AM3)
6/5/2019	15:00 - 15:59	8	11	12
	16:00 - 16:59	9	12	10
	17:00 - 17:59	7	12	10
12/5/2019	15:00 - 15:59	34	30	25
	16:00 - 16:59	32	31	26
	17:00 - 17:59	30	34	30
18/5/2019	15:00 - 15:59	61	37	26
	16:00 - 16:59	52	35	26
	17:00 - 17:59	61	37	30
24/5/2019	15:00 - 15:59	65	47	41
	16:00 - 16:59	67	49	44
	17:00 - 17:59	56	49	44
30/5/2019	15:00 - 15:59	37	43	35
	16:00 - 16:59	49	44	34
	17:00 - 17:59	45	38	29


	1-hr TSP ( $\mu\text{g}/\text{m}^3$ )	24-hr TSP ( $\mu\text{g}/\text{m}^3$ )
Action Level	340	190
Limit Level	500	260

Calibration: Calibration details are shown in appendix F.


Equipment used:

Location	1-hr TSP	24-hr TSP
Reservoir, East Gate and Ash Lagoon	TEOM	TEOM
Tai Yuen Village	-	MINIVOL Portable Sampler

24-hr TSP Air Monitoring Data (February 2019 - March 2019)

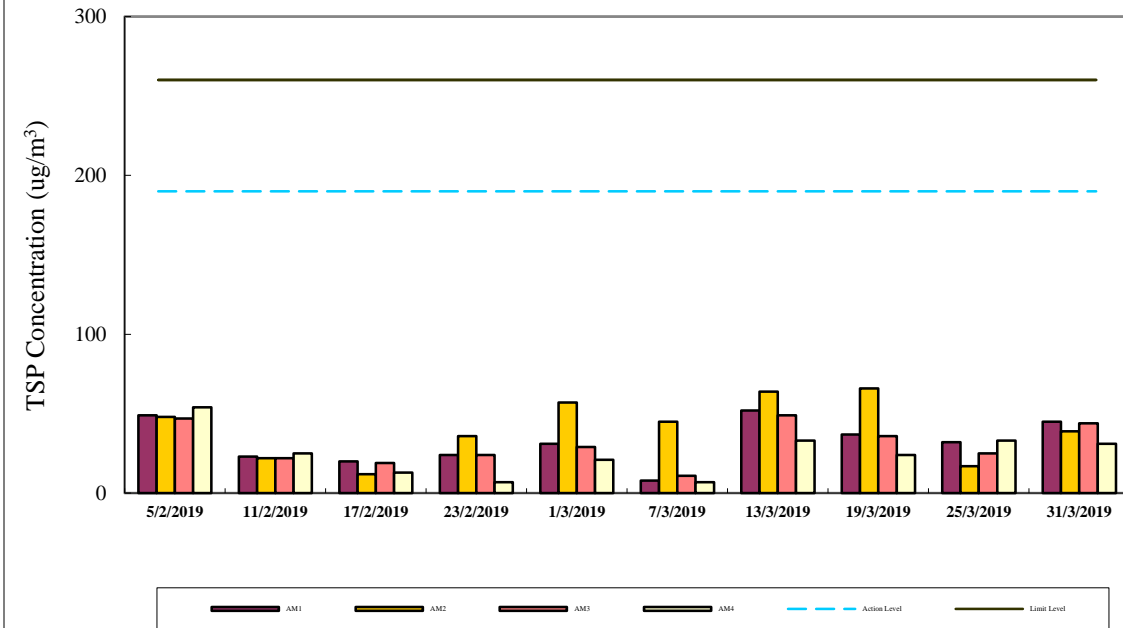


24-hr TSP Air Monitoring Data (April 2019 - May 2019)

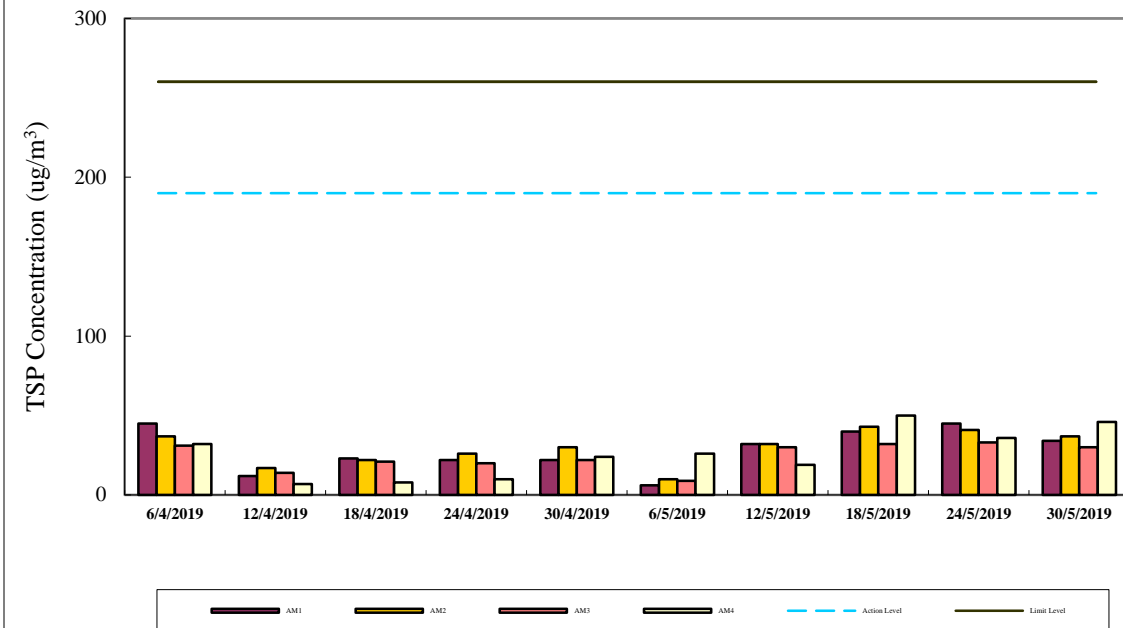




1-hr TSP Air Monitoring Data (February 2019 - March 2019)

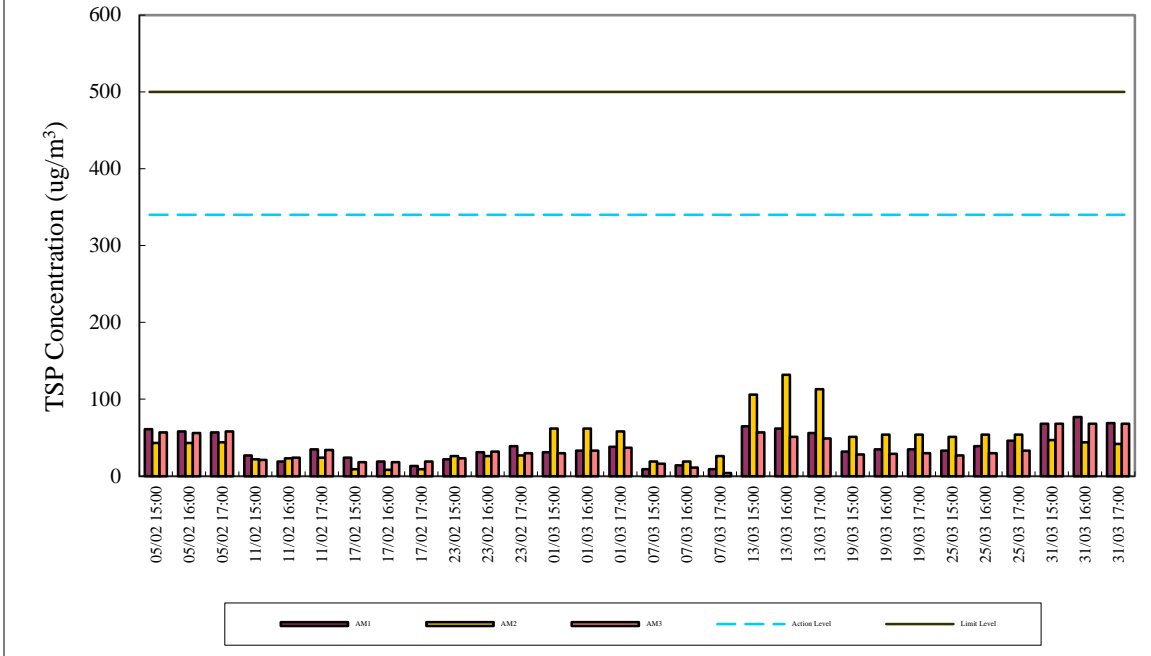

1-hr TSP Air Monitoring Data (April 2019 - May 2019)

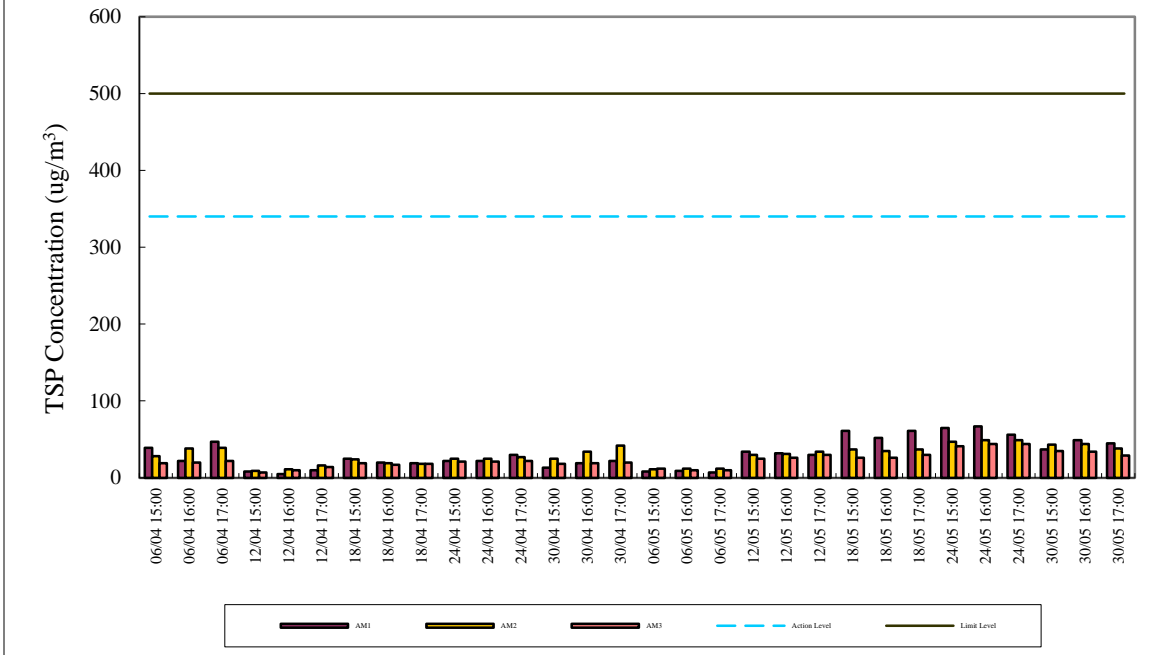

## Appendix E

## Continuous Noise Monitoring Results for May 2019

Site: Lamma Power Station Extension Construction  
 Measurement Location: Ash Lagoon and Ching Lam  
 Measurement Parameter: 30-min Leq (07:00-19:00 hrs on normal weekdays)  
 5-min Leq (07:00-23:00 hrs on holidays and  
 19:00-23:00 hrs on all other days, and 23:00-  
 07:00 hrs of next day)  
 Noise Equipment: B&K 2250 sound level meters and B&K 4231 sound  
 level calibrator  
 Lab. Calibration Date: B&K 2250 sound level meters - 21/06/2018 (Ash Lagoon)  
 02/11/2017 (Ching Lam)  
 B&K 4231 calibrator - 14/10/2018


Date	Time	Calculated Noise Level at NSR at Long Tsai Tsuen/Hung Shing Ye (dB(A))		Limit Noise Level (dB(A))	Calculated Noise Level at NSR at the school within Tai Wan San Tsuen (dB(A))		Limit Noise Level (dB(A))
		Max	Avg		Max	Avg	
01/05/2019	07:00-23:00	46	38	60	57	42	60
01/05/2019	23:00-07:00	43	40	45	42	35	45
02/05/2019	07:00-19:00	44	44	75	42	36	70
02/05/2019	19:00-23:00	49	47	60	41	35	60
02/05/2019	23:00-07:00	45	42	45	44	35	45
03/05/2019	07:00-19:00	---	---	75	43	43	70
03/05/2019	19:00-23:00	---	---	60	46	38	60
03/05/2019	23:00-07:00	44	35	45	45	33	45
04/05/2019	07:00-19:00	---	---	75	47	39	70
04/05/2019	19:00-23:00	41	34	60	52	38	60
04/05/2019	23:00-07:00	40	35	45	45	38	45
05/05/2019	07:00-23:00	53	38	60	49	35	60
05/05/2019	23:00-07:00	38	32	45	44	37	45
06/05/2019	07:00-19:00	---	---	75	47	37	70
06/05/2019	19:00-23:00	45	35	60	48	35	60
06/05/2019	23:00-07:00	45	42	45	42	35	45
07/05/2019	07:00-19:00	---	---	75	48	39	70
07/05/2019	19:00-23:00	49	39	60	51	39	60
07/05/2019	23:00-07:00	45	37	45	44	34	45
08/05/2019	07:00-19:00	---	---	75	44	37	70
08/05/2019	19:00-23:00	---	---	60	39	33	60
08/05/2019	23:00-07:00	45	44	45	41	32	45
09/05/2019	07:00-19:00	---	---	75	57	36	70
09/05/2019	19:00-23:00	---	---	60	41	36	60
09/05/2019	23:00-07:00	45	42	45	44	37	45
10/05/2019	07:00-19:00	---	---	75	48	39	70
10/05/2019	19:00-23:00	---	---	60	48	41	60
10/05/2019	23:00-07:00	45	41	45	44	36	45
11/05/2019	07:00-19:00	---	---	75	45	40	70
11/05/2019	19:00-23:00	---	---	60	41	38	60
11/05/2019	23:00-07:00	42	40	45	42	37	45
12/05/2019	07:00-23:00	47	39	60	50	40	60
12/05/2019	23:00-07:00	40	39	45	41	36	45
13/05/2019	07:00-23:00	---	---	60	41	38	60
13/05/2019	23:00-07:00	42	35	45	42	38	45
14/05/2019	07:00-19:00	---	---	75	45	36	70

14/05/2019	19:00-23:00	---	---	60	50	38	60
14/05/2019	23:00-07:00	44	43	45	44	38	45
15/05/2019	07:00-19:00	---	---	75	46	41	70
15/05/2019	19:00-23:00	---	---	60	51	37	60
15/05/2019	23:00-07:00	39	37	45	42	38	45
16/05/2019	07:00-19:00	58	54	75	53	43	70
16/05/2019	19:00-23:00	---	---	60	44	38	60
16/05/2019	23:00-07:00	45	39	45	43	37	45
17/05/2019	07:00-19:00	---	---	75	53	48	70
17/05/2019	19:00-23:00	---	---	60	56	37	60
17/05/2019	23:00-07:00	43	37	45	43	38	45
18/05/2019	07:00-19:00	---	---	75	54	47	70
18/05/2019	19:00-23:00	---	---	60	58	38	60
18/05/2019	23:00-07:00	41	41	45	40	36	45
19/05/2019	07:00-23:00	60	41	60	57	41	60
19/05/2019	23:00-07:00	43	43	45	45	35	45
20/05/2019	07:00-19:00	52	45	75	58	46	70
20/05/2019	19:00-23:00	42	41	60	55	40	60
20/05/2019	23:00-07:00	44	33	45	45	38	45
21/05/2019	07:00-19:00	---	---	75	49	42	70
21/05/2019	19:00-23:00	49	43	60	59	45	60
21/05/2019	23:00-07:00	45	39	45	45	42	45
22/05/2019	07:00-19:00	51	51	75	51	43	70
22/05/2019	19:00-23:00	---	---	60	50	44	60
22/05/2019	23:00-07:00	45	44	45	45	40	45
23/05/2019	07:00-19:00	---	---	75	61	49	70
23/05/2019	19:00-23:00	---	---	60	60	52	60
23/05/2019	23:00-07:00	44	42	45	45	41	45
24/05/2019	07:00-19:00	---	---	75	62	55	70
24/05/2019	19:00-23:00	---	---	60	60	58	60
24/05/2019	23:00-07:00	42	35	45	38	31	45
25/05/2019	07:00-19:00	52	52	75	61	54	70
25/05/2019	19:00-23:00	---	---	60	60	58	60
25/05/2019	23:00-07:00	45	41	45	40	37	45
26/05/2019	07:00-23:00	58	41	60	60	48	60
26/05/2019	23:00-07:00	45	38	45	41	35	45
27/05/2019	07:00-19:00	52	47	75	51	42	70
27/05/2019	19:00-23:00	---	---	60	50	41	60
27/05/2019	23:00-07:00	42	35	45	44	40	45
28/05/2019	07:00-19:00	54	46	75	63	46	70
28/05/2019	19:00-23:00	25	25	60	47	39	60
28/05/2019	23:00-07:00	45	42	45	45	42	45
29/05/2019	07:00-19:00	---	---	75	65	59	70
29/05/2019	19:00-23:00	---	---	60	60	58	60
29/05/2019	23:00-07:00	45	36	45	42	33	45
30/05/2019	07:00-19:00	---	---	75	66	61	70
30/05/2019	19:00-23:00	---	---	60	60	55	60
30/05/2019	23:00-07:00	45	42	45	45	41	45
31/05/2019	07:00-19:00	60	54	75	69	49	70
31/05/2019	19:00-23:00	---	---	60	47	39	60
31/05/2019	23:00-07:00	45	37	45	44	40	45


Note:



- a. "----" represents the measured noise monitoring data lower than the established notional background level/discarded under strong wind.
- b. Continuous noise monitoring was carried out at holidays & evening-time (07:00-23:00 hrs on holidays and 19:00-23:00 hrs on all other days) and night-time (23:00-07:00 hrs of next day) under construction noise permit.

**Construction Noise Monitoring in February - May 2019**  
 NSR at Long Tsai Tsuen/Hung Shing Ye  
 07:00-19:00 hrs on Normal Weekdays

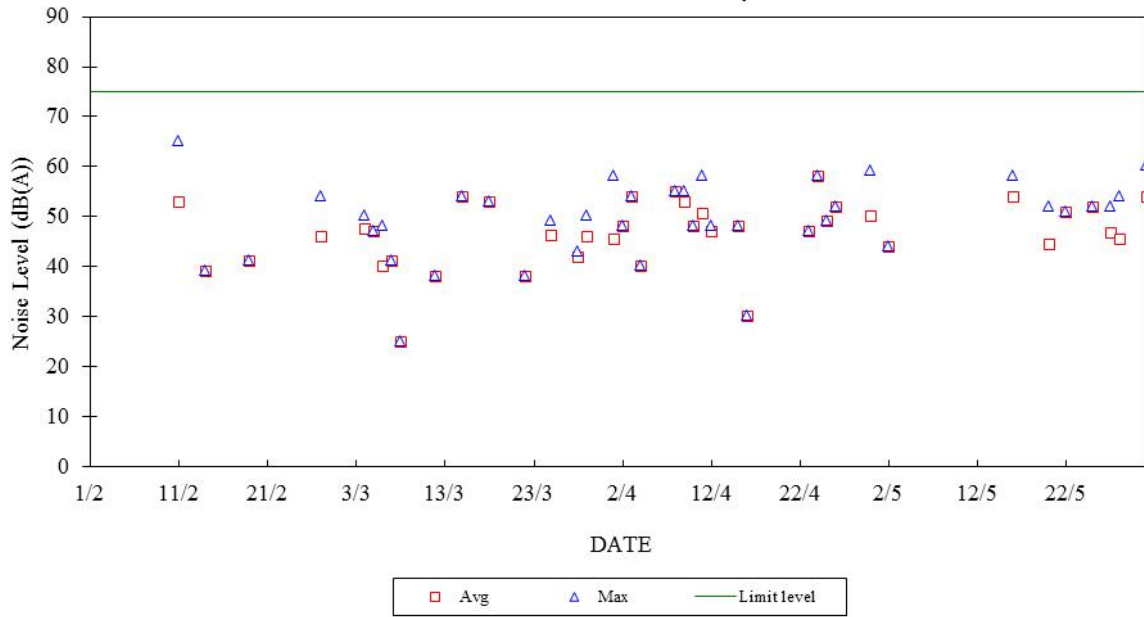


**Construction Noise Monitoring in February - May 2019**  
 NSR at School within Tai Wan San Tsuen  
 07:00-19:00 hrs on Normal Weekdays

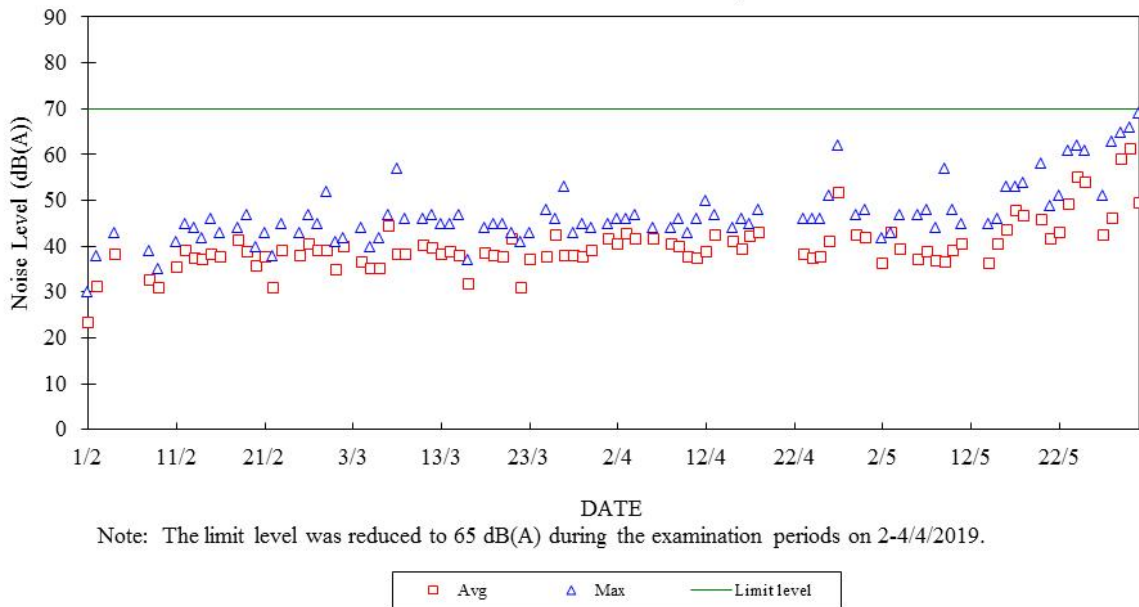


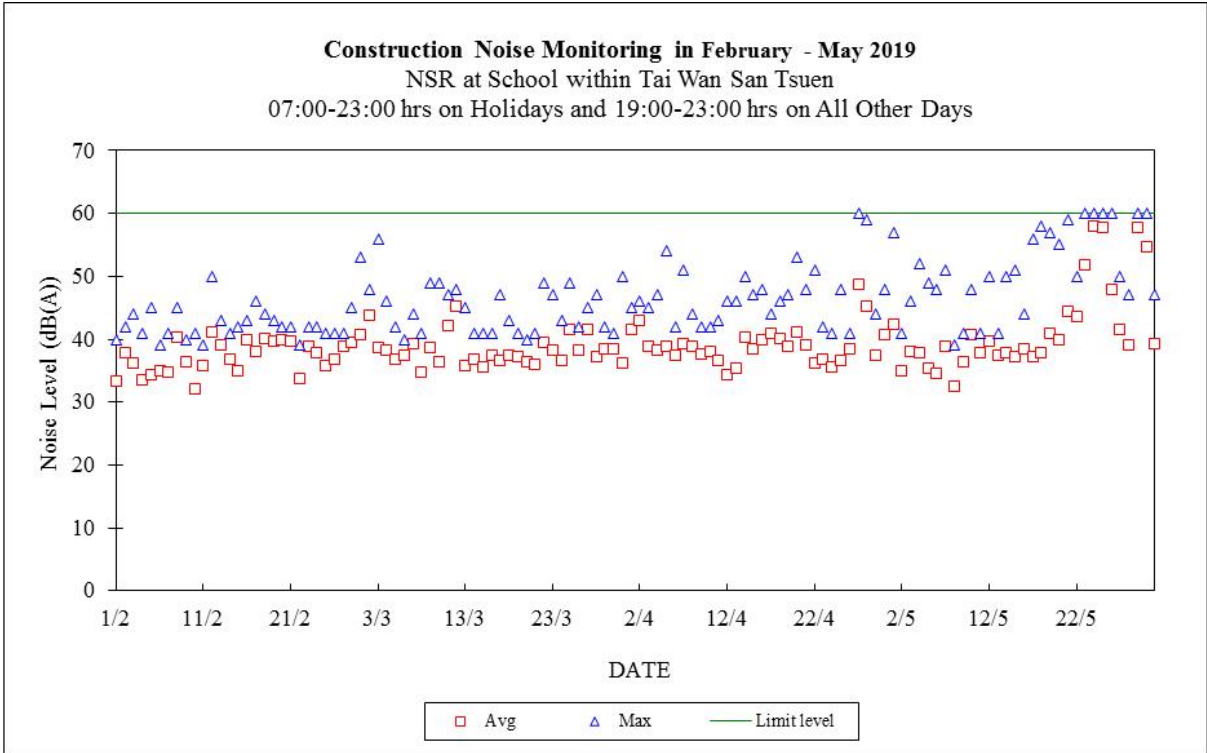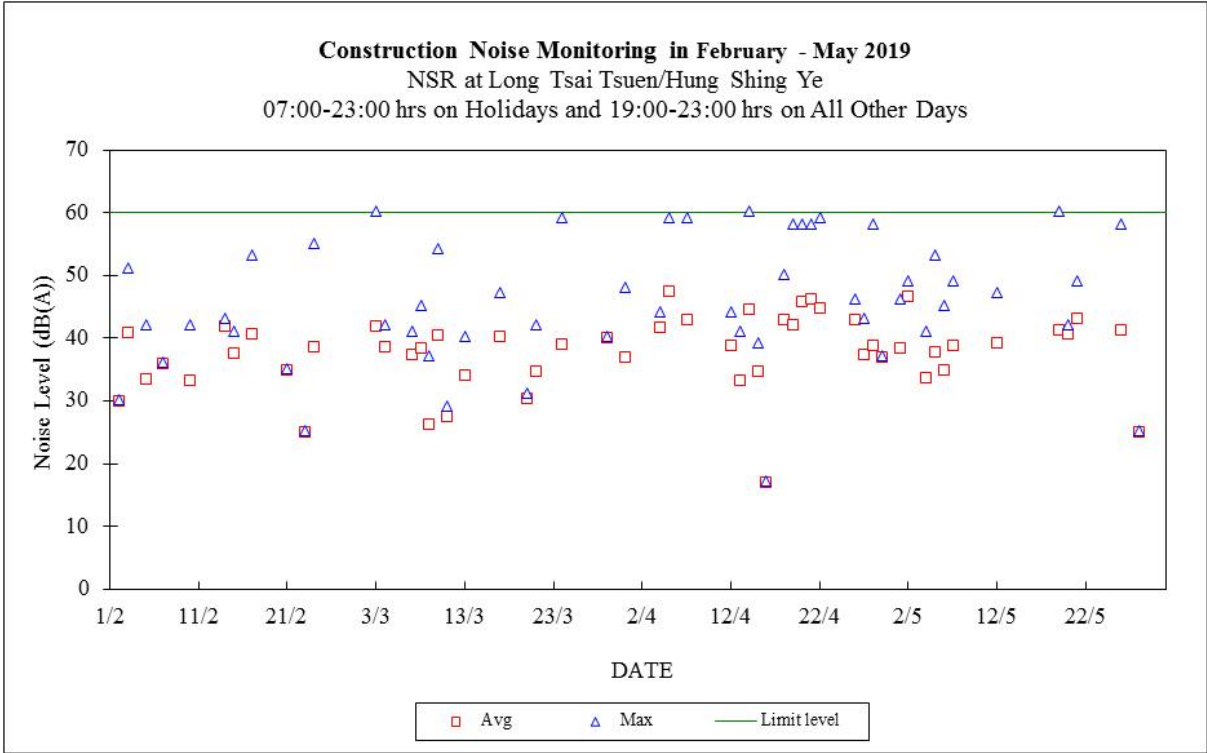

**Construction Noise Monitoring in February - May 2019**  
NSR at Long Tsai Tsuen/Hung Shing Ye  
23:00-07:00 hrs of Next Day

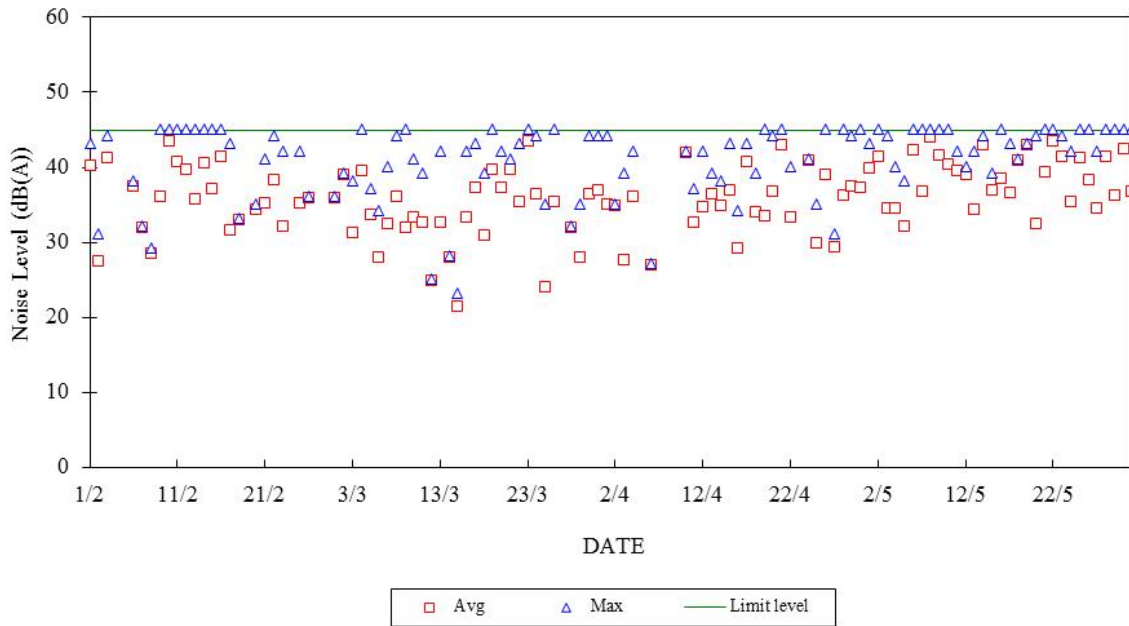

**Construction Noise Monitoring in February - May 2019**  
NSR at School within Tai Wan San Tsuen  
23:00-07:00 hrs of Next Day

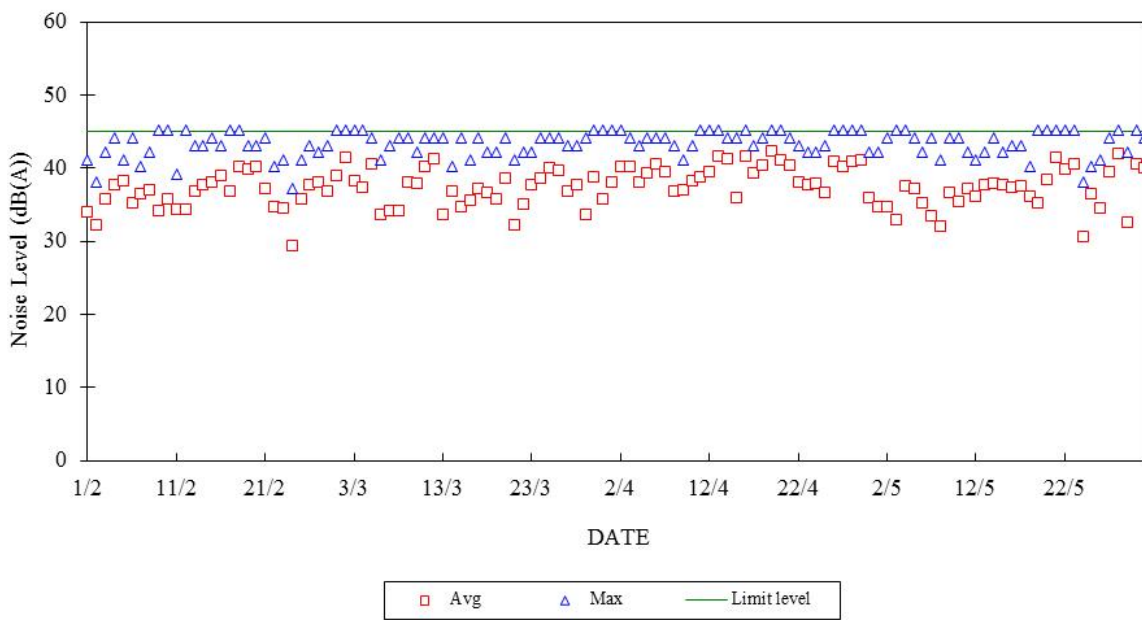

# Appendix F

The QA/QC Procedures and Results

**The Hongkong Electric Co., Ltd.**  
**Lamma Power Station Extension**  
**TEOM Continuous Dust Monitor**  
**Data Quality Assurance Log Sheet**

Month: May Year: 2019

Reservoir (AM1)				
Date	Frequency (Hz) (240 - 275)	Operation Mode (Mode 4)	Main Flow (l/min) (2.70 - 3.30)	Bypass Flow (l/min) (12.30 - 15.04)
06/05/2019	269.318	4	2.99	13.61
12/05/2019	269.050	4	2.95	13.45
18/05/2019	268.575	4	2.88	13.13
24/05/2019	267.977	4	2.97	13.52
30/05/2019	267.687	4	2.96	13.49

East Gate (AM2)				
Date	Frequency (Hz) (240 - 275)	Operation Mode (Mode 4)	Main Flow (l/min) (2.70 - 3.30)	Bypass Flow (l/min) (12.30 - 15.04)
06/05/2019	259.796	4	3.01	13.72
12/05/2019	259.508	4	2.98	13.56
18/05/2019	259.038	4	2.92	13.28
24/05/2019	258.510	4	3.00	13.65
30/05/2019	258.198	4	3.00	13.64

Ash Lagoon (AM3)				
Date	Frequency (Hz) (240 - 275)	Operation Mode (Mode 4)	Main Flow (l/min) (2.70 - 3.30)	Bypass Flow (l/min) (12.30 - 15.04)
06/05/2019	257.951	4	3.00	13.67
12/05/2019	257.688	4	3.00	13.67
18/05/2019	257.332	4	3.00	13.67
24/05/2019	256.858	4	3.00	13.67
30/05/2019	258.744	4	3.00	13.67

Maintenance Record			
	Reservoir	East Gate	Ash Lagoon
TEOM Filter Exchange	✓	✓	✓
Clean TSP Inlet	✓	✓	✓
Replace flow in-line filter	x	x	x
Pump Repair	x	x	x
Leak Check	✓	✓	✓
Flow audit	x	x	x
Flow Controller Calibration	x	x	x
A/C filter cleaning	✓	✓	✓

Remarks:

N/A

Prepared by: H.Y. Chan

Checked by: H.Y. Ho



**The Hongkong Electric Co., Ltd.**  
**Mini Volume Air Sampler Site Visit Log Sheet**

Attendance Log

Site Name: Tai Yuen Village (AM4)

Date/Time	Staff Name
14/05/2019 / 10:30	WM Tam

Equipment / Item

Equipment / Item	Serial No. / No.
MINIVOL	5580
Used filter paper no.	MQ14
New filter paper no.	MQ15

Type of filter: Glass-fibre

- I. Calibration is performed by using Drycal DC-2 Flow Calibrator  
5 std. L/min set point is recommended

Before: 5.00  
After: 5.00 (No adjustment)

- II. General Services

1. Clean Rotameter: Yes
2. Clean / Replace Pump Valves: No
3. Clean / Replace Pump Diaphragms: No
4. Clean Impaction Inlet: Yes
5. Replace Timer Battery Every 6 months: No
6. Replace Inlet Filter: Yes

Remarks

N/A

Conducted by: WM Tam

Checked by: SM Hon

**The Hongkong Electric Co., Ltd.**  
**Lamma Power Station Extension**  
**Noise Monitoring Stations**  
**Daily Calibration Records**

Date	Location: Ash Lagoon		Location: Ching Lam	
	Calibration Results	Deviation from Reference (dB)	Calibration Results	Deviation from Reference (dB)
01/05/2019	Passed	0.01	Passed	-0.01
02/05/2019	Passed	-0.02	Passed	-0.02
03/05/2019	Passed	0.01	Passed	-0.02
04/05/2019	Passed	-0.04	Passed	-0.06
05/05/2019	Passed	-0.01	Passed	-0.03
06/05/2019	Passed	-0.05	Passed	-0.06
07/05/2019	Passed	-0.08	Passed	-0.03
08/05/2019	Passed	-0.05	Passed	-0.06
09/05/2019	Passed	-0.01	Passed	-0.01
10/05/2019	Passed	-0.03	Passed	-0.01
11/05/2019	Passed	0.02	Passed	-0.01
12/05/2019	Passed	0.00	Passed	0.00
13/05/2019	Passed	-0.01	Passed	0.00
14/05/2019	Passed	0.02	Passed	0.04
15/05/2019	Passed	0.05	Passed	0.02
16/05/2019	Passed	0.03	Passed	0.01
17/05/2019	Passed	0.02	Passed	0.03
18/05/2019	Passed	0.04	Passed	0.03
19/05/2019	Passed	0.03	Passed	0.04
20/05/2019	Passed	0.01	Passed	0.05
21/05/2019	Passed	0.04	Passed	-0.03
22/05/2019	Passed	-0.01	Passed	-0.01
23/05/2019	Passed	-0.01	Passed	0.00
24/05/2019	Passed	-0.01	Passed	0.05
25/05/2019	Passed	0.03	Passed	0.05
26/05/2019	Passed	0.00	Passed	0.11
27/05/2019	Passed	0.00	Passed	0.01
28/05/2019	Passed	-0.01	Passed	-0.02
29/05/2019	Passed	-0.05	Passed	-0.02
30/05/2019	Passed	-0.01	Passed	0.01
31/05/2019	Passed	-0.02	Passed	-0.01

Remarks:

1. The B&K sound level meter at the noise monitoring station has an advanced feature of internal calibration checking (viz. Charge Injection Calibration (CIC)). CIC is a B&K patented method for in situ verification of the integrity of the entire sound measurement chain (including microphone, preamplifier and cabling).
2. The acceptance criterion of deviation from reference is  $\pm 0.5$  dB.

## Appendix G Event/Action Plans

Table G.1 Event and Action Plans for Air Quality

Event	Monitoring		Action	
	ET Leader	IEC	Engineer	Contractor
<b>Action Level</b>				
Exceedance of one sample	Identify source Inform Engineer and IEC verbally Repeat measurement to confirm finding	Check monitoring data submitted by ET and advise Engineer.	Notify Contractor Checking monitoring data and contractor's working methods	Rectify any unacceptable practice amend any working methods if appropriate
Exceedance of two or more consecutive samples	Identify source Inform Engineer and IEC verbally Repeat measurement to confirm finding Increase monitoring frequency Discuss with Engineer and Contractor on remedial actions required If exceedance continues, arrange meeting with Engineer If exceedance stops, discontinue additional monitoring	Check monitoring data submitted by ET and advise Engineer. Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Confirm receipt of notification of failure in writing Notify contractor Checking monitoring data and contractor's working methods Discuss proposed remedial actions with the ET and Contractor Ensure remedial actions properly implemented	Submit proposals for remedial actions to Engineer within 3 working days of notifications Implement the agreed proposals Amend proposal if appropriate
<b>Limit level</b>				
Exceedance of one sample	Repeat measurement to confirm finding. Identify the source(s) of the impact. If the exceedance is found to be valid and due to the Construction works, verbally advise the Contractor, Engineer and IEC, and inform the EPD of the exceedance, as soon as practicable. Increase monitoring frequency to daily Assess the effectiveness of the contractor's remedial actions and keep Engineer, IEC and EPD informed of the results	Check monitoring data submitted by ET and advise Engineer Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Confirm receipt of notification of failure in writing Notify Contractor Checking monitoring data and Contractor's working method Discuss with ET and Contractor on remedial actions to be provided Ensure remedial measures properly implemented	Take immediate action to avoid further exceedance Submit proposals for remedial actions to Engineer within 3 working days of notifications Implement the agreed proposals Amend proposal if appropriate
Exceedance of two or more	Identify source	Provide feedback to the Engineer on the remedial actions proposed by the	Confirm receipt of notification of	Take immediate action to

Event	Monitoring		Action	
	ET Leader	IEC	Engineer	Contractor
consecutive samples	<p>If the exceedance is found to be valid and due to the construction works, verbally advise the Contractor, Engineer and IEC, and inform the EPD of the exceedance as soon as practicable.</p> <p>Repeat measurement to confirm finding</p> <p>Increase monitoring frequency to daily</p> <p>Carry out analysis of Contractor's working procedures to determine possible mitigation to be implemented</p> <p>Arrange meeting with Engineer and Contractor to discuss the remedial actions to be taken</p> <p>If exceedance stops, discontinue additional monitoring</p>	<p>ET / Contractor</p> <p>Advise Engineer on the effectiveness of the proposed remedial measures</p> <p>Verify the implementation of the remedial measures</p>	<p>failure in writing</p> <p>Checking monitoring data and Contractor's working methods</p> <p>Notify Contractor</p> <p>Discuss proposed remedial actions with ET and Contractor</p> <p>Ensure remedial measures properly implemented</p> <p>If exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop the portion of work until the exceedance is abated</p>	<p>avoid further exceedance</p> <p>Submit proposals for remedial actions to Engineer within 3 working days of notifications</p> <p>Implement the agreed proposals</p> <p>Resubmit proposals if problem still not under control</p> <p>Stop the relevant portion of works as determined by the Engineer until the exceedance is abated</p>

Table G.2 Event and Action Plans for Construction Noise

Exceedance	ET Leader	IEC	Engineer	Contractor
<b>Action Level</b>	Undertake noise measurement/check monitoring data to establish validity of complaint.	Review the analysed results submitted by the ET.	Notify Contractor of the complaint if proven.	Submit proposals for remedial actions to Engineer.
	If the complaint is valid, inform Engineer and IEC verbally.	Review the remedial measures proposed by the Contractor and advise the Engineer and ET accordingly.	Check Contractor's working methods and advise IEC and ET accordingly.	Amend proposals if required by the Engineer.
	Identify the source(s) of the noise.	Verify the implementation of the remedial measures.	Remind the Contractor of his contractual obligations and discuss remedial actions.	Implement the remedial actions immediately upon instruction from the Engineer.
	Discuss remedial actions required with Contractor and Engineer.		Keep the Contractor informed of the efficacy of remedial actions.	Liaise with the Engineer to optimise the effectiveness of the agreed mitigation.
	Increase manual monitoring frequency to assess efficacy of remedial measures.			
	If exceedance continues, review implementation of appropriate mitigation measures.			
<b>Limit Level</b>	Repeat manual measurement/check monitoring data to confirm findings.	Agree potential remedial actions with Engineer, ET and Contractor.	Notify Contractor of exceedance.	Take immediate action to avoid further exceedance.
	Identify the source(s) of the impact. If the exceedance is found to be valid and due to the Construction works, verbally advise the Contractor, Engineer and IEC, and inform the EPD of the exceedance, as soon as practicable.	Review Contractor's remedial actions / measures to ensure their effectiveness and advise the Engineer and ET accordingly.	Check Contractor's working methods and advise IEC and ET accordingly.  Discuss with Contractor the remedial actions to be implemented.	Submit proposals for remedial actions to Engineer.  Amend proposals if required by the Engineer.
	Discuss remedial actions required with Engineer.	Verify the implementation of the remedial measures	Keep the Contractor informed of the efficacy of remedial actions. If the exceedance continues, consider what portion of the work is responsible and instruct the Contractor to stop the portion of work until the exceedance is abated	Implement remedial actions immediately upon instruction from the Engineer. If the exceedance continues, consider what portion of the work is responsible and, as instructed by the Engineer, stop the portion of work until the exceedance is abated
	Increase manual monitoring frequency to assess efficacy of remedial measures.			

Table G.3 Event and Action Plans for Water Quality

<b>Exceedance</b>	<b>ET Leader</b>	<b>IEC</b>	<b>Engineer</b>	<b>Contractor</b>
Action level exceeded on one sampling day	Verbally inform the Contractor, and IEC. Repeat in-situ measurement to confirm findings; Identify source(s) of impact; Check monitoring data, all plant, equipment and Contractor's working methods; Discuss mitigation measures with Engineer and Contractor; Repeat measurement on next day of exceedance.	Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Discuss with Contractor the proposed mitigation measures; Make agreement on the mitigation measures to be implemented; Assess the effectiveness of the implemented mitigation measures.	Inform the Engineer and confirm notification of the non-compliance in writing; Rectify unacceptable practice; Check all plant and equipment; Consider changes of working methods; Propose and discuss mitigation measures with Engineer; Implement the agreed mitigation measures.
Action level exceeded on more than one consecutive sampling day	Repeat in-situ measurements to confirm findings; Identify source(s) of impact; Inform Contractor and IEC; Check monitoring data, all plant, equipment and Contractor's working methods; Discuss mitigation measure with Engineer and Contractor; Ensure mitigation measures are implemented; Prepare to increase the monitoring frequency to daily; Repeat measurement on next day of exceedance.	Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Discuss with ET and Contractor on the proposed mitigation measures; Make agreement on the mitigation measures to be implemented; Assess the effectiveness of the implemented mitigation measures.	Inform the Engineer and confirm notification of the non-compliance in writing; Rectify unacceptable practice; Check all plant and equipment; Consider changes of working methods; Propose mitigation measures to Engineer within 3 working days and discuss with ET and Engineer; Implement the agreed mitigation measures.
Limit level exceeded on one sampling day	Verbally inform the Contractor, IEC and the EPD of the exceedance; Repeat in-situ measurement to confirm findings; Identify source(s) of impact; Check monitoring data, all plant,	Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor Advise Engineer on the effectiveness of the proposed remedial measures Verify the implementation of the remedial measures	Discuss with Contractor on the proposed mitigation measures; Request Contractor to critically review the working methods; Make agreement on the mitigation measures to be implemented; Assess the effectiveness of the	Inform the Engineer and confirm notification of the non-compliance in writing; Rectify unacceptable practice; Check all plant and equipment; Consider changes of working methods; Propose mitigation measures to Engineer

<b>Exceedance</b>	<b>ET Leader</b>	<b>IEC</b>	<b>Engineer</b>	<b>Contractor</b>
	<p>equipment and Contractor's working methods;</p> <p>Discuss mitigation measure with Engineer and Contractor;</p> <p>Ensure mitigation measures are implemented;</p> <p>Increase the monitoring frequency to daily until no exceedance of Limit level.</p>		<p>implemented mitigation measures.</p>	<p>within 3 working days and discuss with Engineer;</p> <p>Implement the agreed mitigation measures.</p>
<p>Limit level exceeded by more than one consecutive sampling day</p>	<p>Repeat in-situ measurement to confirm findings;</p> <p>Identify source(s) of impact;</p> <p>Inform Contractor, IEC and EPD;</p> <p>Check monitoring data, all plant, equipment and Contractor's working methods;</p> <p>Discuss mitigation measure with Engineer and Contractor;</p> <p>Ensure mitigation measures are implemented;</p> <p>Increase the monitoring frequency to daily until no exceedance of Limit level for two consecutive days.</p>	<p>Provide feedback to the Engineer on the remedial actions proposed by the ET / Contractor</p> <p>Advise Engineer on the effectiveness of the proposed remedial measures</p> <p>Verify the implementation of the remedial measures</p>	<p>Discuss with Contractor on the proposed mitigation measures;</p> <p>Request Contractor to critically review the working methods;</p> <p>Make agreement on the mitigation measures to be implemented;</p> <p>Assess the effectiveness of the implemented mitigation measures;</p> <p>Consider and instruct, if necessary, the Contractor to slow down or to stop all or part of the marine works until no exceedance of the Limit Level.</p>	<p>Inform the Engineer and confirm notification of the non-compliance in writing;</p> <p>Rectify unacceptable practice;</p> <p>Check all plant and equipment; Consider changes of working methods;</p> <p>Propose mitigation measures to Engineer within 3 working days and discuss with Engineer;</p> <p>Implement the agreed mitigation measures..</p> <p>As directed by the Engineer, to slow down or to stop all or part of the marine work</p>

## **Appendix H Summary of Site Audit Findings**

### L10 Civil & Building Superstructure Work

Dates of Inspection: 07/05/2019, 17/05/2019, 23/05/2019 and 28/05/2019

#### Summary of Findings

##### *General*

- No environmental deficiency identified.

##### *Air Quality*

- No environmental deficiency identified.

##### *Noise*

- No environmental deficiency identified.

##### *Water Quality*

- No environmental deficiency was identified.

##### *Waste Management*

- No environmental deficiency identified.



L10 Mechanical, Electrical, Instrumentation & Control Erection Work

Dates of Inspection: 02/05/2019, 09/05/2019, 16/05/2019, 23/05/2019 and 30/05/2019.

Summary of Findings

*General*

- No environmental deficiency identified.

*Air Quality*

- No environmental deficiency identified.

*Noise*

- No environmental deficiency identified.

*Water Quality*

- No environmental deficiency identified.

*Waste Management*

- No environmental deficiency identified.

## L11 Civil & Building Superstructure Work

Dates of Inspection: 07/05/2019, 17/05/2019, 23/05/2019 and 28/05/2019.

### Summary of Findings

#### *General*

- No environmental deficiency identified.

#### *Air Quality*

- No environmental deficiency identified.

#### *Noise*

- No environmental deficiency identified.

#### *Water Quality*

- No environmental deficiency identified.

#### *Waste Management*

- No environmental deficiency identified.

## L12 Piling Foundation Work

Dates of Inspection: 03/05/2019, 09/05/2019, 16/05/2019 24/05/2019 and 31/05/2019

### Summary of Findings

#### *General*

- No environmental deficiency identified.

#### *Air Quality*

- No environmental deficiency identified.

#### *Noise*

- No environmental deficiency identified.

#### *Water Quality*

- No environmental deficiency was identified.

#### *Waste Management*

- No environmental deficiency identified.

## Summary of EMIS

### Power Station – (Part B of EIA Report)

#### Construction Phase Mitigation Measures and their Implementation

EM&A Log Ref.	Mitigation Measures	Implementation Status
	<b>AIR QUALITY</b>	
A1	For general construction works, the dust control measures stipulated under the Air Pollution Control (Construction Dust) Regulation shall be complied with, such as: <ul style="list-style-type: none"> <li>the haul roads shall be sprayed with water to keep the entire road surface wet.</li> <li>the load carried by vehicle shall be covered by impervious sheeting to ensure no leakage of dusty materials from the vehicle.</li> <li>the heights from which fill materials are dropped shall be controlled to a practical level to minimise the fugitive dust arising from unloading.</li> </ul>	C C C
A2	For the concrete batching plant, the following control measures are recommended: <ul style="list-style-type: none"> <li>loading, unloading, handling, transfer or storage of any dusty materials shall be carried out in a totally enclosed system.</li> <li>The materials which may generate airborne dust emissions shall be wetted by water spray system.</li> <li>All receiving hoppers shall be enclosed on three sides up to 3m above unloading point.</li> <li>All conveyor transfer points shall be totally enclosed.</li> </ul>	C C C C
	<b>WATER QUALITY</b>	
B1	Silt curtains shall be installed on the eastern, southern and north western sides of the reclamation site during dredging for the reclamation construction. This is a required mitigation measure for the construction works and shall be implemented prior to the commencement of bulk dredging. **	N/A
B3	As a necessary operational constraint combined bulk dredging and sand filling for site formation shall not be permitted at any time. In addition, sand filling for site platform shall take place behind constructed sea walls which pierce the water surface. **	N/A
B4	HEC shall ensure design to divert all storm drains away from Hung Shing Ye Bay. **	N/A
B5	Sand fill for the rubble mound seawalls shall be placed by controlled pumping down the trailer arm. **	N/A
B6	EM&A shall confirm the acceptability of any impacts during construction and should any unacceptable impacts be found then one or more of the following mitigation measures shall be implemented: ** <ul style="list-style-type: none"> <li>reducing the number of dredgers working at any one time;</li> <li>reducing the rate of working of the dredgers;</li> <li>temporary suspension of operations;</li> <li>phasing of the works so that dredging / filling is only undertaken at certain stages of the tidal cycle.</li> </ul>	N/A

EM&A Log Ref.	Mitigation Measures	Implementation Status
B7	<p>In addition to the above specific measures the following general working procedures shall be adopted. **</p> <ul style="list-style-type: none"> <li>• fully-enclosed or watertight grabs shall be used to minimise loss of sediment during the raising of loaded grabs through the water column;</li> <li>• the descent speed of grabs shall be controlled to minimise the seabed impact speed and to reduce the volume of over dredging;</li> <li>• barges shall be loaded carefully to avoid splashing of material;</li> <li>• all barges used for the transport of dredged materials shall be fitted with tight bottom seals in order to prevent leakage of material during loading and transport;</li> <li>• all barges shall be filled to a level which ensures that material does not spill over during loading and transport to the disposal site and that adequate freeboard is maintained to ensure that the decks are not washed by wave action;</li> <li>• the speed of trailer dredgers shall be controlled to prevent propeller wash from stirring up the sea bed sediments;</li> <li>• "rainbowing" sand fill from trailer dredgers shall not be permitted; and</li> <li>• the works shall cause no visible foam, oil, grease or litter or other objectionable matter to be present in the water within and adjacent to the dredging site and along the route to the disposal site.</li> </ul>	  N/A N/A N/A N/A N/A N/A N/A N/A
B8	<p>Cumulative impacts shall be assessed through EM&amp;A. Co-ordination with the EM&amp;A consultants for other projects to determine if any exceedances are caused by the other projects or by HEC's activities. Should monitoring results indicate exceedances at sensitive receivers due to HEC's activities, then the above described mitigation measures shall be implemented until impacts reduce to acceptable levels. **</p>	N/A
<b>NOISE</b>		
C1	<p>General noise mitigation measures shall be employed at all work sites throughout the construction phase.</p>	C
C2	<p>Mitigate against general construction noise during Sunday's and public holidays, either at source with portable noise barriers, or by rescheduling of some PME's to less sensitive time periods.</p>	C
C3	<p>Mitigate against night time noise from dredging equipment, with silencers or mufflers. **</p>	N/A
<b>LANDSCAPE &amp; VISUAL IMPACTS</b>		
D1	<p>The following mitigation measures shall be allowed for landscape and visual improvement:</p> <ul style="list-style-type: none"> <li>• Use rubble mound seawall along south and west edges of the reclamation to provide a more natural look.</li> <li>• Break the mass of main buildings by varying the height/division into smaller units.</li> <li>• Plant trees and vegetation for screening.</li> <li>• Adopt colour scheme to blend the buildings into the scenery.</li> </ul>	  C C C C

EM&A Log Ref.	Mitigation Measures	Implementation Status
<b>WASTE MANAGEMENT</b>		
E1	HEC to submit a Waste Management Plan for the construction phase to EPD. The Plan shall be verified by the IEC and shall describe the arrangements for avoidance, reuse, recovery and recycling, storage, collection, treatment and disposal of different categories of waste to be generated from the construction activities and shall take into account the recommendations of the EIA report.	C
<i>Dredging Waste</i>		
E2	All vessels for marine transportation of dredged sediment shall be fitted with tight fitting seals to their bottom openings to prevent leakage of materials. In addition, loading of barges and hoppers shall be controlled to prevent splashing of dredged material into the surrounding water, and barges or hoppers should under no circumstances be filled to a level which shall cause the overflowing of materials or polluted water during loading or transportation**	N/A
<i>Storage, Collection and Transport of Waste</i>		
E3	<ul style="list-style-type: none"> <li>• Minimise windblown litter and dust during transportation by either covering trucks or transporting wastes in enclosed containers.</li> </ul>	C
	<ul style="list-style-type: none"> <li>• Obtain the necessary waste disposal permits from the appropriate authorities, if they are required, in accordance with the Waste Disposal Ordinance (Cap.354), Waste Disposal (Chemical Waste) (General) Regulation (Cap.354), the Crown Land Ordinance (Cap 28), Dumping at Sea Ordinance (Cap 466) and Work Branch Technical Circular No. 22/92, Marine Disposal of Dredged Mud.</li> </ul>	C
	<ul style="list-style-type: none"> <li>• Disposal of waste at Licensed sites;</li> </ul>	C
	<ul style="list-style-type: none"> <li>• Develop procedures such as a ticketing system to facilitate tracking of marine mud and chemical waste, and to ensure that illegal disposal does not occur;</li> </ul>	C
	<ul style="list-style-type: none"> <li>• Segregate and sort the waste materials into 3 categories:               <ul style="list-style-type: none"> <li>• public fill (e.g. concrete and rubble) for re-use on-site or disposal at a public filling area;</li> <li>• re-use and/or recycling waste (e.g. steel and other metals);</li> <li>• waste which cannot be re-used and/or recycled (e.g. wood, glass and plastic) for landfill disposal.</li> <li>• The sorting process shall be carefully monitored to avoid missing of the 3 categories. Different types of wastes shall be stockpiled and stored in different containers or skips to enhance re-use or recycling of materials and their proper disposal.</li> </ul> </li> </ul>	C
<ul style="list-style-type: none"> <li>• Maintain records of the quantities of wastes generated and disposed off-site for each category of waste.</li> </ul>	C	
E4	Chemical waste that is produced, as defined by Schedule 1 of the Waste Disposal (Chemical Waste) (General) Regulation, shall be handled in accordance with the Code of Practice on the Packaging, Handling and Storage of Chemical Wastes	C
<b>LAND CONTAMINATION</b>		
F1	No land Contamination mitigation measures are required during the construction phase.	N/A
<b>MARINE ECOLOGY</b>		

<b>EM&amp;A Log Ref.</b>	<b>Mitigation Measures</b>	<b>Implementation Status</b>
G1	All percussive piling works shall be conducted on reclaimed land to avoid noise impact to marine mammals**	N/A
G2	All construction related vessels shall approach the extension site from the north and via the East Lamma Channel to avoid disturbance to the finless porpoise**	N/A
G3	Rubble mound seawall to the south and west edges of the reclamation to enhance recolonisation of marine organisms**	N/A
G4	Artificial Reefs of a volume not less than 400 m <sup>3</sup> shall be deployed in a location to be decided upon consultation with the Director of Agriculture and Fisheries to serve the purpose of an Additional Habitat Enhancement Measure.**	N/A
<b>FISHERIES</b>		
H1	No Fisheries-specific mitigation measures are required during the construction phase.	N/A
<b>RISK ASSESSMENT</b>		
I1	No risk mitigation measures are required during the construction phase.	N/A

## Remarks:

- \*\* - No dredging and reclamation work would be involved for L10, L11 & L12 construction
- C - Compliance with mitigation measure
- NC - Non-compliance with mitigation measure
- N/A - Not Applicable

16/8002 Outstanding Work Programme

16-8002 OS Work Prog (08May19).mpp

21/05/19

ID	Task Name	Duration	Start	Finish	May '19	Jun '19	Jul '19	Aug '19
1	<b>16/8002 Unit 10 Outstanding Work Programme</b>	<b>354 days</b>	<b>01/12/18</b>	<b>29/11/19</b>	[Summary bar]			
2	<b>Unit 10 MSB &amp; HRSG</b>	<b>354 days</b>	<b>01/12/18</b>	<b>29/11/19</b>	[Summary bar]			
3	<b>Superstructure</b>	<b>202 days</b>	<b>01/12/18</b>	<b>30/06/19</b>	[Summary bar]			
4	<b>Upper Roof</b>	<b>107 days</b>	<b>01/12/18</b>	<b>27/03/19</b>	[Summary bar]			
5	Tiling works	30 days	01/12/18	01/01/19	[Summary bar]			
6	Remaining Waterproofing + screed + touch up	14 days	16/01/19	29/01/19	[Summary bar]			
7	Finishing for lift machine room except defer works	21 days	02/01/19	22/01/19	[Summary bar]			
8	Installation remaining handrails & hatch doors & catladder	21 days	23/01/19	20/02/19	[Summary bar]			
9	Miscellaneous work & cleaning after plant erection clearance	35 days	21/02/19	27/03/19	[Summary bar]			
10	<b>5/F</b>	<b>152 days</b>	<b>12/12/18</b>	<b>22/05/19</b>	[Summary bar]			
11	Complete Vent fan support @ rooflight	35 days	15/01/19	26/02/19	[Summary bar]			
12	Installation of internal enclosure @ rooflight	14 days	27/02/19	12/03/19	[Summary bar]			
13	Removal of scaffold insider Rooflights	30 days	01/04/19	30/04/19	[Summary bar]			
14	Complete & touch up rooflights façade	10 days	01/05/19	10/05/19	[Summary bar]			
15	Remaing Waterproofing + screed	21 days	09/01/19	29/01/19	[Summary bar]			
16	Touch up painting & floor joints	21 days	30/01/19	27/02/19	[Summary bar]			
17	Construction of defer RC wall & feature at north of Air filter Inlet	45 days	08/04/19	22/05/19	[Summary bar]			
18	Complete pump room for FS installation	21 days	30/01/19	27/02/19	[Summary bar]			
19	Complete Air Filter Plant Room	21 days	28/02/19	20/03/19	[Summary bar]			
20	Installation of GRS Water Tanks & Plumbing works	30 days	21/03/19	19/04/19	[Summary bar]			
21	Installation of Stainless Steel Pole	7 days	13/04/19	19/04/19	[Summary bar]			
22	Touch up remaining metal works	14 days	28/02/19	13/03/19	[Summary bar]			
23	Miscellaneous work & cleaning after plant erection clearance	14 days	09/05/19	22/05/19	[Summary bar]			
24	Removal of remaining external scaffold	21 days	12/12/18	03/01/19	[Summary bar]			
25	Allow access at East Elevation from roof level	0 days	03/04/19	03/04/19	[Summary bar]			
26	Roof Feature at East Elevation	45 days	03/04/19	17/05/19	[Summary bar]			
27	<b>4/F</b>	<b>101 days</b>	<b>21/01/19</b>	<b>09/05/19</b>	[Summary bar]			
28	Installation of grating & handrail to overhead crane walkway	45 days	21/01/19	15/03/19	[Summary bar]			
29	TDK remove scaffolding for step installation	0 days	15/03/19	15/03/19	[Summary bar]			
30	Installation of steps & Handrail to overhead crane walkway	14 days	15/03/19	28/03/19	[Summary bar]			
31	Touch up remaining metal works	14 days	29/03/19	11/04/19	[Summary bar]			
32	Touch up painting	14 days	12/04/19	25/04/19	[Summary bar]			
33	Miscellaneous work & cleaning after plant erection clearance	14 days	26/04/19	09/05/19	[Summary bar]			
34	<b>3/F</b>	<b>105 days</b>	<b>01/03/19</b>	<b>13/06/19</b>	[Summary bar]			
35	Delivery and Installation of fire proof window (Re-work)	70 days	01/03/19	09/05/19	[Summary bar]			
36	Finishing touching up works at viewing gallery	14 days	10/05/19	23/05/19	[Summary bar]			
37	Touch up remaining metal works	14 days	10/05/19	23/05/19	[Summary bar]			
38	Touch up painting at other areas	7 days	24/05/19	30/05/19	[Summary bar]			
39	Miscellaneous work & cleaning after plant erection clearance	14 days	31/05/19	13/06/19	[Summary bar]			
40	<b>2/F</b>	<b>42 days</b>	<b>08/03/19</b>	<b>18/04/19</b>	[Summary bar]			
41	Installation of grating & handrail to overhead crane walkway	21 days	08/03/19	28/03/19	[Summary bar]			
42	Miscellaneous work & cleaning after plant erection clearance	21 days	29/03/19	18/04/19	[Summary bar]			
43	<b>1/F</b>	<b>66 days</b>	<b>15/01/19</b>	<b>29/03/19</b>	[Summary bar]			
44	Complete IBP installation and return site from TDK	0 days	15/01/19	15/01/19	[Summary bar]			
45	Durasteel steel partition and cat ladder installation at Loading Bay	35 days	15/01/19	26/02/19	[Summary bar]			
46	Touch up remaining metal works	21 days	16/02/19	08/03/19	[Summary bar]			
47	Miscellaneous work & cleaning after plant erection clearance	21 days	09/03/19	29/03/19	[Summary bar]			

16-8002 OS Work Prog (08May19)

Critical Split ..... Task [Pattern] Split ..... Milestone ◆ Summary [Arrow]



16/8002 Outstanding Work Programme

16-8002 OS Work Prog (08May19).mpp

21/05/19

ID	Task Name	Duration	Start	Finish	May '19	Jun '19	Jul '19	Aug '19
48	<b>M/F +12.15mPD Mainenance Platform</b>	<b>28 days</b>	<b>01/06/19</b>	<b>28/06/19</b>		01 Jun '19	28 Jun '19	
49	Plant erection clearance	0 days	01/06/19	01/06/19		Plant erection clearance		
50	Floor Screeding	14 days	01/06/19	14/06/19		Floor Screeding		
51	Miscellaneous work & cleaning	14 days	15/06/19	28/06/19		Miscellaneous work & cleaning		
52	<b>G/F</b>	<b>202 days</b>	<b>01/12/18</b>	<b>30/06/19</b>			30 Jun '19	
53	RC slabs at remaining rooms	21 days	15/12/18	06/01/19				
54	Toilets finishing Works	21 days	07/01/19	27/01/19				
55	Installation of Shutter at South	14 days	14/01/19	27/01/19				
56	Lube Oil RC Walls	21 days	01/12/18	21/12/18				
57	Remaining RC entrance lobbies (NE & E)	14 days	22/12/18	06/01/19				
58	Return Condenser from Plant ejection	0 days	06/03/19	06/03/19				
59	Remaining Floor slabs at Condenser Area	21 days	06/03/19	26/03/19				
60	Modify GL G-H/6 Bracing	10 days	24/02/19	06/03/19				
61	Return Unloading Bay from Plant ejection (G.L G~H)	0 days	15/03/19	15/03/19				
62	On-Grade slab at Unloading Bay (G.L. G~H)	14 days	15/03/19	28/03/19	-H)			
63	Erection of Shutter at East	6 days	22/03/19	27/03/19				
64	Scaffold erection + Defer Cladding at East elevation	45 days	03/04/19	17/05/19		Scaffold erection + Defer Cladding at East elevation		
65	RC external walls at East Elevation + Tiling	45 days	15/03/19	28/04/19		C external walls at East Elevation + Tiling		
66	<b>TDK scaffold removal @ G/F</b>	<b>0 days</b>	<b>01/05/19</b>	<b>01/05/19</b>		TDK scaffold removal @ G/F		
67	Installation GRP tank above meter room incl. plumbing system	21 days	01/05/19	21/05/19		Installation GRP tank above meter room incl. plumbing system		
68	Install remaining Steel & metalwork and drainage channel covers	30 days	01/05/19	30/05/19		Install remaining Steel & metalwork and drainage channel covers		
69	Touch up remaining metal works	14 days	31/05/19	13/06/19		Touch up remaining metal works		
70	Touch up painting	30 days	31/05/19	29/06/19		Touch up painting		
71	TDK Return Unloading Bay (G.L F~G)	0 days	10/06/19	10/06/19		TDK Return Unloading Bay (G.L F~G)		
72	Completion of floor slab @ unloading bay and touch up	7 days	10/06/19	16/06/19		Completion of floor slab @ unloading bay and touch up		
73	Install FS & Electrical work @ Unloading Bay	14 days	17/06/19	30/06/19		Install FS & Electrical work @ Unloading Bay		
74	Miscellaneous work & cleaning	21 days	10/06/19	30/06/19		Miscellaneous work & cleaning		
75	<b>Transformer Area</b>	<b>85 days</b>	<b>21/01/19</b>	<b>23/04/19</b>	'19			
76	Completion of Plant Installation	0 days	21/01/19	21/01/19				
77	Installation of Roofing and Fence Louvre walls	21 days	21/01/19	18/02/19				
78	Installation of Building Services	50 days	19/02/19	09/04/19	ervices			
79	Removal of scaffoldings	14 days	10/04/19	23/04/19	l of scaffoldings			
80	<b>Link Bridge</b>	<b>132 days</b>	<b>14/01/19</b>	<b>02/06/19</b>		02 Jun '19		
81	Scaffold erection	10 days	14/01/19	23/01/19				
82	Roof Cladding	21 days	24/01/19	21/02/19				
83	Fire partition & internal panels	45 days	22/02/19	07/04/19	els			
84	Vertical Cladding Panels	14 days	08/04/19	21/04/19	adding Panels			
85	Floor tiles	21 days	22/02/19	14/03/19				
86	Downpipe installation	14 days	15/03/19	28/03/19				
87	FS and Electrical Installation	21 days	22/04/19	12/05/19		FS and Electrical Installation		
88	Additional Handrail & Door Replacement at U10 side	21 days	13/05/19	02/06/19		Additional Handrail & Door Replacement at U10 side		
89	<b>Others</b>	<b>162 days</b>	<b>15/12/18</b>	<b>04/06/19</b>		04 Jun '19		
90	Staircase ST-01 + Lift Lobbies	45 days	21/03/19	04/05/19		Staircase ST-01 + Lift Lobbies		
91	Staircase ST-02 + Lobbies	30 days	05/04/19	04/05/19		Staircase ST-02 + Lobbies		
92	Fendolite touch up	60 days	16/03/19	14/05/19		Fendolite touch up		
93	Door leaf installation (Remains)	45 days	31/03/19	14/05/19		Door leaf installation (Remains)		
94	U9 Cantilever Beam improvement work	30 days	04/05/19	02/06/19		U9 Cantilever Beam improvement work		
95	Remaining Drainage & Plumbing Works for Building	45 days	20/04/19	03/06/19		Remaining Drainage & Plumbing Works for Building		

16-8002 OS Work Prog (08May19)

Critical Split ..... Task  Split  Milestone  Summary 

16/8002 Outstanding Work Programme

16-8002 OS Work Prog (08May19).mpp

21/05/19

ID	Task Name	Duration	Start	Finish	May '19	Jun '19	Jul '19	Aug '19
96	Signage Installation	21 days	15/05/19	04/06/19	Signage Installation			
97	Lift Installation incl. T&C	120 days	15/12/18	23/04/19	Lift Installation incl. T&C			
98	Electrical Installation incl. T&C	120 days	02/03/19	29/06/19	Electrical Installation incl. T&C			
99	MVAC Installation incl. T&C	120 days	02/03/19	29/06/19	MVAC Installation incl. T&C			
100	FS Installation incl. T&C	120 days	02/03/19	29/06/19	FS Installation incl. T&C			
101	<b>External Works</b>	<b>215 days</b>	<b>30/03/19</b>	<b>30/10/19</b>	<b>External Works</b>			
102	EVA North MSB	105 days	30/03/19	12/07/19	EVA North MSB			
103	Dia 900 Storm Drain (fr east to west) & FS PFH Pipe	0 days	30/03/19	30/03/19	Dia 900 Storm Drain (fr east to west) & FS PFH Pipe			
104	TDK remove air filter inlet scaffold	0 days	08/04/19	08/04/19	TDK remove air filter inlet scaffold			
105	Remain Dia900 storm drain to MH204	28 days	08/04/19	05/05/19	Remain Dia900 storm drain to MH204			
106	Access and Complete east rc wall	12 days	30/04/19	11/05/19	Access and Complete east rc wall			
107	Access to TDK for transport steam blow pipes fr Gate 39	10 days	06/05/19	15/05/19	Access to TDK for transport steam blow pipes fr Gate 39			
108	Access to TDK for transport steam blow pipes fr HRSG	21 days	16/05/19	05/06/19	Access to TDK for transport steam blow pipes fr HRSG			
109	Dia 400 Storm Drain at G.L. G-H	8 days	08/05/19	15/05/19	Dia 400 Storm Drain at G.L. G-H			
110	Road gully to storm manhole (east)	5 days	23/05/19	27/05/19	Road gully to storm manhole (east)			
111	Conduits for streetlight and fs signal (east)	7 days	28/05/19	03/06/19	Conduits for streetlight and fs signal (east)			
112	Road base (East)	7 days	04/06/19	10/06/19	Road base (East)			
113	Remaing FS OFH Pipe + concrete box (west)	14 days	16/05/19	29/05/19	Remaing FS OFH Pipe + concrete box (west)			
114	Sewage Drain SM207C to SM207	12 days	20/05/19	31/05/19	Sewage Drain SM207C to SM207			
115	Provision for PDE Tx Bay work @ MH204	2 days	30/05/19	31/05/19	Provision for PDE Tx Bay work @ MH204			
116	Return from PDE (North of Tx Bay)	0 days	22/06/19	22/06/19	Return from PDE (North of Tx Bay)			
117	Road gully to storm manhole (west)	4 days	01/06/19	04/06/19	Road gully to storm manhole (west)			
118	Conduits for streetlight and fs signal (to Station Rd)	7 days	18/06/19	24/06/19	Conduits for streetlight and fs signal (to Station Rd)			
119	Road base + Paving (remainings)	18 days	25/06/19	12/07/19	Road base + Paving (remainings)			
120	EVA West MSB	78 days	02/05/19	18/07/19	EVA West MSB			
121	Dia 900 Storm Drain to MH203	14 days	02/05/19	15/05/19	Dia 900 Storm Drain to MH203			
122	Manhole MS213b & associated drain pipes	7 days	09/05/19	15/05/19	Manhole MS213b & associated drain pipes			
123	FS OFH Pipe + concrete box	14 days	16/05/19	29/05/19	FS OFH Pipe + concrete box			
124	Sewage drain pump pit to SM206a	12 days	19/05/19	30/05/19	Sewage drain pump pit to SM206a			
125	TDK Site crane at West of SunShade	14 days	31/05/19	13/06/19	TDK Site crane at West of SunShade			
126	Dia 1200 pipe connect to MH202	7 days	31/05/19	06/06/19	Dia 1200 pipe connect to MH202			
127	New Cable trenches	18 days	01/06/19	18/06/19	New Cable trenches			
128	Road gully to storm manhole	7 days	19/06/19	25/06/19	Road gully to storm manhole			
129	Conduits for streetlight and fs signal	10 days	14/06/19	23/06/19	Conduits for streetlight and fs signal			
130	Road kerb	7 days	24/06/19	30/06/19	Road kerb			
131	Road base + Paving	18 days	01/07/19	18/07/19	Road base + Paving			
132	EVA South MSB	64 days	09/05/19	11/07/19	EVA South MSB			
133	Dia 450 & 600 Storm Drain MH214-217A	14 days	09/05/19	22/05/19	Dia 450 & 600 Storm Drain MH214-217A			
134	Sewage SM208E to pump pit	14 days	23/05/19	05/06/19	Sewage SM208E to pump pit			
135	Portable & Flushing along MSB south wall	14 days	09/05/19	22/05/19	Portable & Flushing along MSB south wall			
136	FS OFH Pipe + concrete box	18 days	23/05/19	09/06/19	FS OFH Pipe + concrete box			
137	Road gully to storm manhole	7 days	10/06/19	16/06/19	Road gully to storm manhole			
138	Conduits for streetlight and fs signal	14 days	10/06/19	23/06/19	Conduits for streetlight and fs signal			
139	Road base + Paving	18 days	24/06/19	11/07/19	Road base + Paving			
140	EVA North HRSG	62 days	15/07/19	14/09/19	EVA North HRSG			
141	Area Return from TDK	0 days	15/07/19	15/07/19	Area Return from TDK			
142	Road gully to storm manhole	12 days	15/07/19	26/07/19	Road gully to storm manhole			
143	Conduits for steeltlight and fs signal	18 days	27/07/19	13/08/19	Conduits for steeltlight and fs signal			

16-8002 OS Work Prog (08May19)

Critical Split ..... Task

Split


Milestone ◆

Summary

16/8002 Outstanding Work Programme

16-8002 OS Work Prog (08May19).mpp

21/05/19

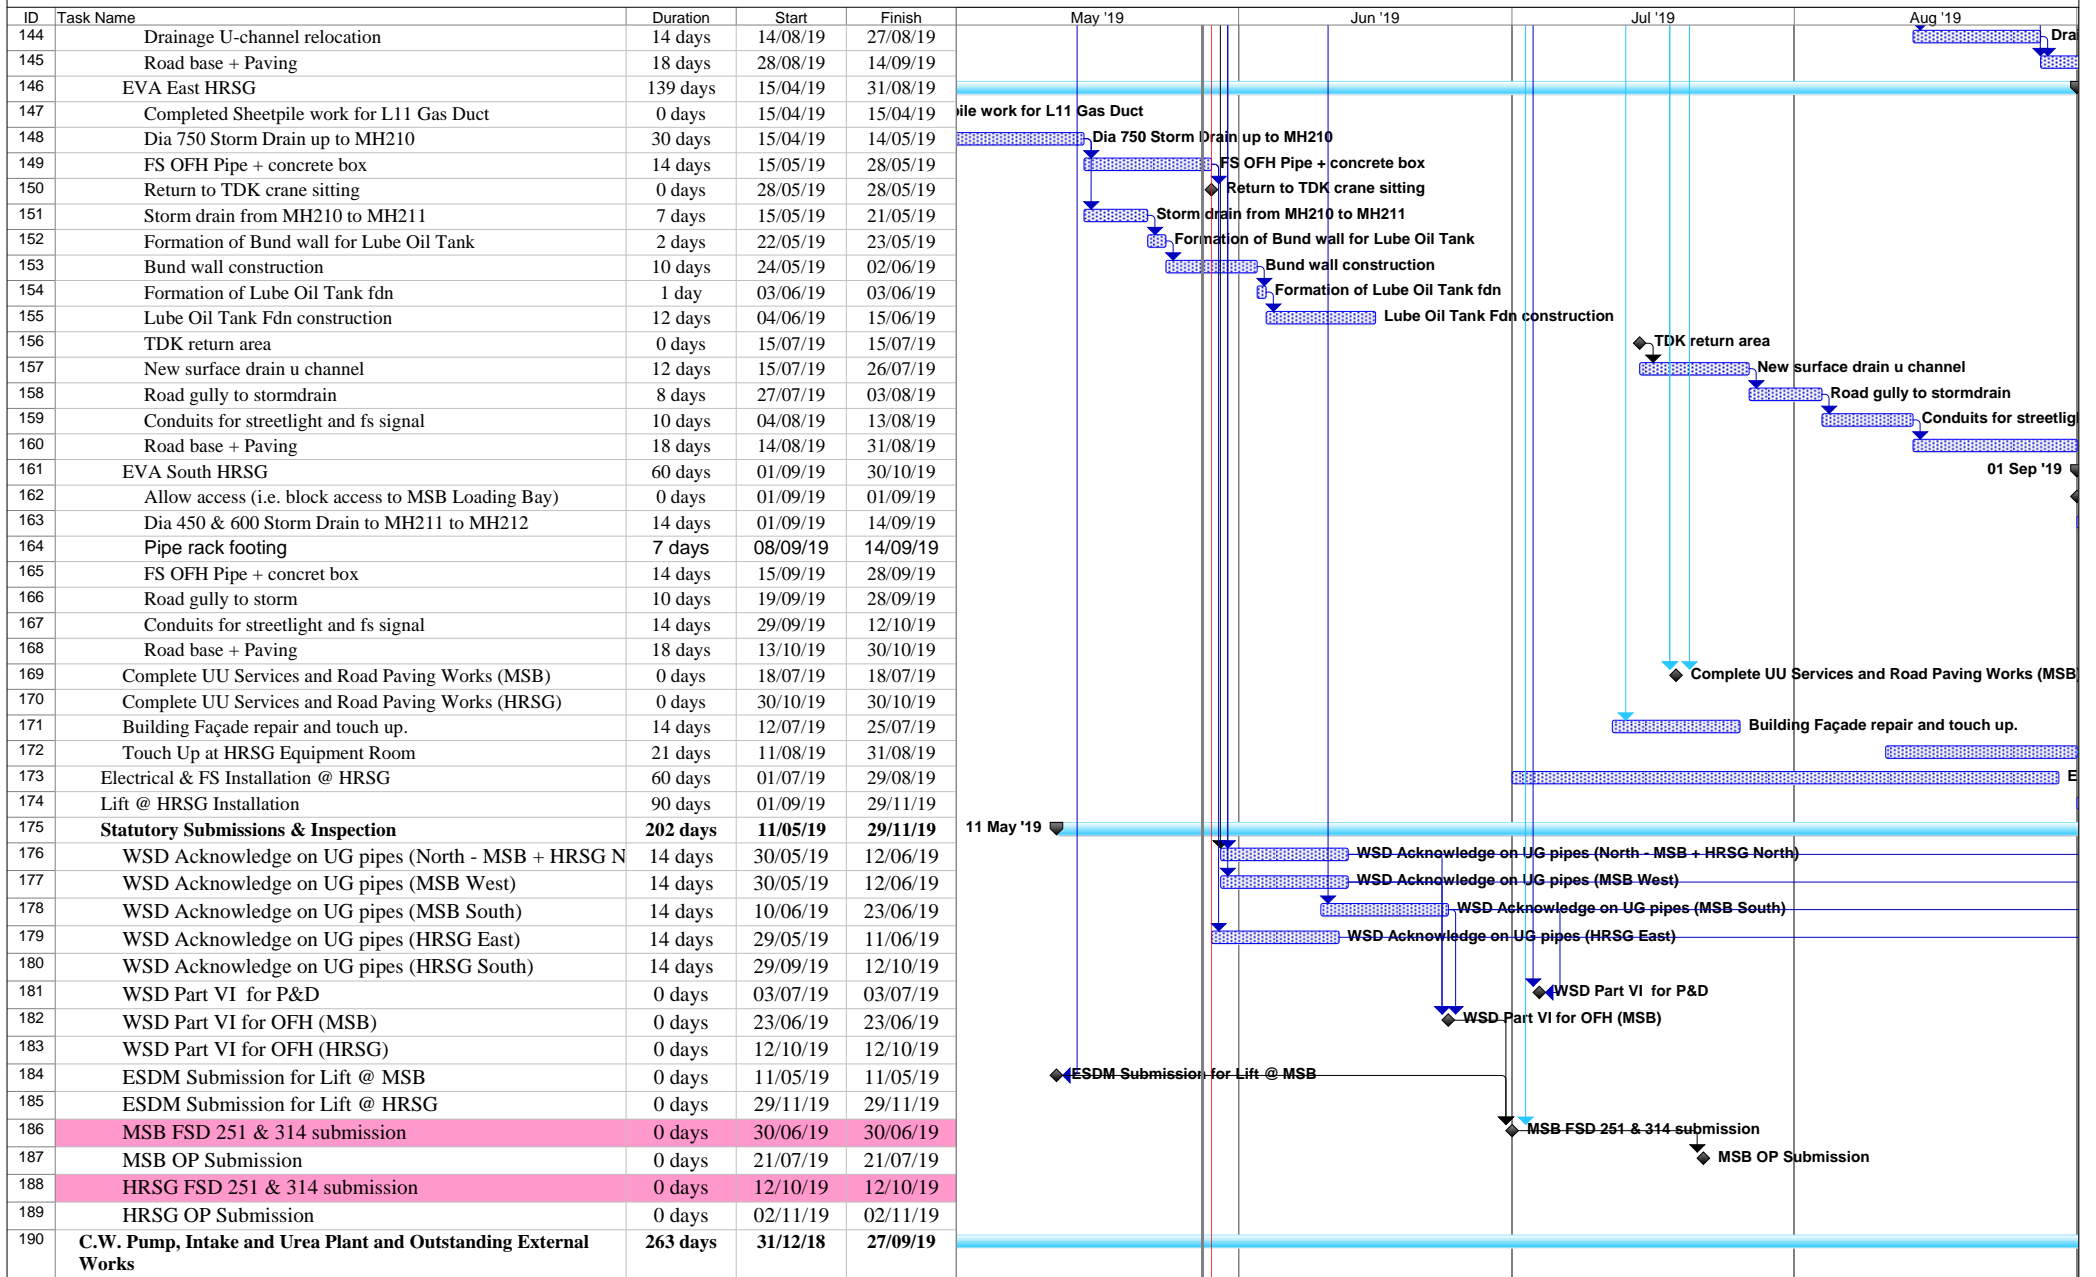

16/8002 Outstanding Work Programme

16-8002 OS Work Prog (08May19).mpp

21/05/19

ID	Task Name	Duration	Start	Finish	May '19	Jun '19	Jul '19	Aug '19
191	C.W. Pump Area incl. Chlorination Area	167 days	14/01/19	07/07/19	07 Jul '19			
192	Cable tray at pipe rack ready for power supply laying	0 days	31/01/19	31/01/19				
193	Power supply laying and T&C for BS installation at CW. Pump Equip. Room	60 days	31/01/19	08/04/19	&C for BS installation at CW. Pump Equip. Room			
194	Building's work touch up	30 days	09/04/19	08/05/19	Building's work touch up			
195	TDK confirm not use of temp. access to CW Intake	0 days	14/01/19	14/01/19				
196	Drainage construction under Chlorination area	21 days	14/01/19	11/02/19				
197	Bearing inspection by BD	30 days	12/02/19	13/03/19				
198	Foundation Construction of Chlorination area	21 days	14/03/19	03/04/19	Chlorination area			
199	Above ground RC @ Chlorination area	21 days	04/04/19	24/04/19	Above ground RC @ Chlorination area			
200	RC plinths & Backfill	14 days	25/04/19	08/05/19	RC plinths & Backfill			
201	Drainage and FS Pipe up to mid-way to MH821	30 days	25/04/19	24/05/19	Drainage and FS Pipe up to mid-way to MH821			
202	Divert Access to Intake	10 days	25/05/19	03/06/19	Divert Access to Intake			
203	Remain surface drainage FS pipe etc along CW Pump Pav	30 days	04/06/19	03/07/19	Remain surface drainage FS pipe etc along CW Pump Pavement			
204	Road Reinstatement at Demin. Plant Road	30 days	25/05/19	23/06/19	Road Reinstatement at Demin. Plant Road			
205	Relocation Hoarding to middle road and return area to GEN	14 days	24/06/19	07/07/19	Relocation Hoarding to middle road and return area to GEN			
206	Urea Plant + Middle Road	206 days	31/12/18	01/08/19	01 Aug '19			
207	Handover for plant erection	0 days	31/12/18	31/12/18				
208	Building Services and raised floors for Urea Ele. Equip Roc	14 days	02/01/19	15/01/19				
209	Cable Tray ready at Pipe rack for power laying	0 days	08/04/19	08/04/19	Back for power laying			
210	Power laying and T&C for BS at Urea Ele. Equip Rm	30 days	09/04/19	08/05/19	Power laying and T&C for BS at Urea Ele. Equip Rm			
211	TDK Return area construction	0 days	15/04/19	15/04/19	Construction			
212	Removal of existing drainage U-Channel	14 days	15/04/19	28/04/19	Removal of existing drainage U-Channel			
213	New Oily Drain installation and diversion of foam pipe	21 days	29/04/19	19/05/19	New Oily Drain installation and diversion of foam pipe			
214	Storm Drain MH830a to MH809	14 days	20/05/19	02/06/19	Storm Drain MH830a to MH809			
215	Storm Drain MH831 to MH830a	14 days	03/06/19	16/06/19	Storm Drain MH831 to MH830a			
216	Storm Drain MH832 & MH837 to MH831	14 days	17/06/19	30/06/19	Storm Drain MH832 & MH837 to MH831			
217	Storm Drain at Urea Pavement	14 days	01/07/19	14/07/19	Storm Drain at Urea Pavement			
218	FS Pipe at West of Urea	14 days	01/07/19	14/07/19	FS Pipe at West of Urea			
219	Conduits for steetlight and fs signal	14 days	15/07/19	28/07/19	Conduits for steetlight and fs signal			
220	Road Kerb + Road Base + Paving	60 days	03/06/19	01/08/19	Road Kerb + Road Base + Paving			
221	Construction of RC bund wall, step, slab, etc.	40 days	15/04/19	24/05/19	Construction of RC bund wall, step, slab, etc.			
222	Erection of Removable Metal cladding	21 days	11/05/19	31/05/19	Erection of Removable Metal cladding			
223	Installation of folding shutters	21 days	01/06/19	21/06/19	Installation of folding shutters			
224	Urea Shelter BD approval + Consent	0 days	19/05/19	19/05/19	Urea Shelter BD approval + Consent			
225	Urea Shelter Fdn and superstructure	30 days	03/06/19	02/07/19	Urea Shelter Fdn and superstructure			
226	Remaining paving works	14 days	03/07/19	16/07/19	Remaining paving works			
227	<b>Other &amp; External works</b>	<b>261 days</b>	<b>02/01/19</b>	<b>27/09/19</b>				
228	Chimney Remaining Installation works for L10	90 days	02/01/19	09/04/19	Installation works for L10			
229	Return from ground treatment at North of Area B1 & D2	0 days	01/04/19	01/04/19	North of Area B1 & D2			
230	Site Clearance for Paving at Middle Road to Chimney Rd	30 days	01/05/19	30/05/19	Site Clearance for Paving at Middle Road to Chimney Rd			
231	New Pipe Rack foundation Under L11 Contract (FYI)	60 days	31/05/19	29/07/19	New Pipe Rack foundation Under L11 Contract			
232	Road Paving and other service reinstatement	60 days	30/07/19	27/09/19	Road Paving and other service reinstatement			

SCHEDULE C. Contract No. 16/2209  
 Lamma Power Station Extension - Unit 10  
 Complete Erection, Inspection, Testing &  
 Commissioning of Power Block Facilities

Appendix J  
**FOR  
 INFO**

No.	Description	2019		
		Jun	Jul	Aug
	<b>Erection Key Date</b>	⑤		
		Syn chro		
<b>A</b>	<b>HRSG PORTION</b>			
A-01	Install Casing (Bottom/Side/Top) with Structure			
A-02	Upper/Lower Connection Pipe			
A-03	Module Install (Bundle Tube Block)			
A-04	Down Commer Pipe			
A-05	Drum Lifting / HDR Level Adjustment			
A-06	Critical Piping/connecting piping (Main Steam, Aux, R/H, HP/LP Feed Water)			
A-07	Other piping			
A-08	Access Platform / Hand Rail			
A-09	Inside Baffle Plate & Seismic Tie Adjust / Setting			
A-10	SCR System			



SCHEDULE C. Contract No. 16/2209  
 Lamma Power Station Extension - Unit 10  
 Complete Erection, Inspection, Testing &  
 Commissioning of Power Block Facilities

Appendix 1  
**FOR  
 INFO**

No.	Description	2019		
		Jun	Jul	Aug
	<b>Erection Key Date</b>	⑤		
		Syn chro		
		▼		
A-11	Inlet Duct Structure / Include Pipe Rack (U9-U10 Connection)			
A-12	Inlet Duct			
A-13	Exhaust Duct Structure			
A-14	Exhaust Duct			
A-15	Aux Equip(B/D Tank, HP/IP Feed Water Pump, LP Eco Recirculation Pump, etc.)  HP/IP Feed Water Pump  Reserve feed water Tank	Final		
A-16	Insulation			
A-17	Painting			
A-18	Install Catalyst	▼	●	
A-19	Steam Blowing out(other scope) & alkaline boiling out			

SCHEDULE C. Contract No. 16/2209  
 Lamma Power Station Extension - Unit 10  
 Complete Erection, Inspection, Testing &  
 Commissioning of Power Block Facilities

Appendix  
**FOR  
 INFO**

No.	Description	2019		
		Jun	Jul	Aug
	<b>Erection Key Date</b>	⑤		
		Syn chro		
	Installation of Temporary piping, Support & Silencer Exception of Steam blowing out Dismantle of Temporary piping, Support & Silencer Exception of Steam boiling out			
<b>B</b>	<b>GT/ST/GEN PORTION</b>			
B-1	Turbine O/H Crane			
B-2	Condenser			
B-3	Install ST	Lube Oil Install Final		

SCHEDULE C. Contract No. 16/2209  
 Lamma Power Station Extension - Unit 10  
 Complete Erection, Inspection, Testing &  
 Commissioning of Power Block Facilities

Appendix J  
**FOR  
 INFO**

No.	Description	2019		
		Jun	Jul	Aug
	<b>Erection Key Date</b>	⑤		
		Syn chro		
B-4	Install GEN	GT Spin Blow / T		
B-5	Install GT			



SCHEDULE C. Contract No. 16/2209  
 Lamma Power Station Extension - Unit 10  
 Complete Erection, Inspection, Testing &  
 Commissioning of Power Block Facilities

Appendix  
**FOR  
 INFO**

No.	Description	2019		
		Jun	Jul	Aug
	<b>Erection Key Date</b>	⑤		
		Syn chro		
B-6	Aux Equipment			
B-7	Insulation			
B-8	Painting			
B-9	Switchgear/Hoist/Hoist for condenser			

SCHEDULE C. Contract No. 16/2209  
 Lamma Power Station Extension - Unit 10  
 Complete Erection, Inspection, Testing &  
 Commissioning of Power Block Facilities

Appendix  
**FOR  
 INFO**

No.	Description	2019		
		Jun	Jul	Aug
	<b>Erection Key Date</b>	⑤		
		Syn chro		
<b>C</b>	<b>ERECTION &amp; INSTRUMENTATION PORTION</b>			
C-1	Transformer & Ancillaries (G Tx, U Tx, Ex Tx, SFC Tx)			
C-2	<b>EQUIPMENT INSTALLATION</b>			
	Generator & Ancillaries			
	Isolated Phase Busducts			
	Switchgear and Accessories			
	UPS, Batterys, Battery Charger System & DBs			
	Electrical Panels & Local Control Panels			
	Control Systems, Control Panels, Local Instrument Cubicle & Rack			
	Channel Base Installation			
C-3	<b>CABLING SYSTEM INSTALLATION</b>			
	Cable Ladder / Tray Installation			
	Conduit Pipe Installation			
	Earthing Installation			
	Cable Laying & Termination			
	Fire Resistant Sealing			
	Cable Trench Opening & Transportation			

SCHEDULE C. Contract No. 16/2209  
 Lamma Power Station Extension - Unit 10  
 Complete Erection, Inspection, Testing &  
 Commissioning of Power Block Facilities

Appendix J  
**FOR  
 INFO**

No.	Description	2019		
		Jun	Jul	Aug
	<b>Erection Key Date</b>	⑤		
		Syn chro		
C-4	INSTRUMENTS, INSTR. PIPINGS & AIR TUBE			
	Local Instruments, Piping & Tubing			
	Instrument Calibration			
C-5	OTHER WORK			
	275kV Shunt Reactor Relocation			—
	Turbine Overhead Crane, Hoist, Battery Power Supply			
	Existing CWP etc.			
	BOP & Other Works			
	Site Cleaning			
C-6	TESTING & COMMISSIONING			
	Testing & Commissioning			
	Commissioning Assistant			—

ID	Task Name	Duration	Start	Finish	2019		
					Jun 2019	Jul 2019	Aug 2019
1	<b>Civil and Building Works for Unit 11 and Associated Works</b>	<b>1197 days</b>	<b>01/06/18</b>	<b>30/09/21</b>			
2	<b>Contract Key Dates</b>	<b>1197 days</b>	<b>01/06/18</b>	<b>30/09/21</b>			
3	Contract Commencement Date	0 days	01/06/18	01/06/18			
4	<b>Completion Dates</b>	<b>1044 days</b>	<b>31/10/18</b>	<b>30/09/21</b>			
5	Section A1 - Ground treatment installation works at Zone 1A	0 days	31/10/18	31/10/18			
6	Section A2 - Ground treatment installation works at Zone 1B	0 days	31/10/18	31/10/18			
7	Section A3 - Ground treatment installation works at Zone 2	0 days	17/03/19	17/03/19			
8	Section A4 - Ground treatment installation works at Zone 3	0 days	21/03/19	21/03/19			
9	Section A5 (i) - Ground treatment installation works at Zone 4 - Band drain installation	0 days	28/03/19	28/03/19			
10	Section A5 (ii) - Ground treatment installation works at Zone 4 - Surcharge filling	0 days	30/09/20	30/09/20			
11	Section A6 (i) - A&A Works for No. 4 C.W. Outfall at Area E18	0 days	28/03/20	28/03/20			
12	Section A6 (ii) - External works at Area E15	0 days	15/02/20	15/02/20			
13	Section B1 (i) - Area south of L11 MSB and HRSG from GL11-F eastwards leading to Chimney Road at Area E1 & E2	0 days	01/03/20	01/03/20			
14	Section B1 (ii) - Supporting structures for overhead cranes of L11 MSB including the associated roof structure except the roof deferred works	0 days	17/03/20	17/03/20			
15	Section B1 (iii) - FSRU Civil works at Area E13	0 days	31/05/21	31/05/21			
16	Section B2 - Retractable Cover D at Area E22	0 days	31/03/20	31/03/20			
17	Section B3 - External works at Area B1, D2 and D4	0 days	30/04/20	30/04/20			
18	Section C1 - Area south of L11 MSB from GL11-F westwards leading to Station Road at Area E3(A) & E3(B)	0 days	01/03/20	01/03/20			
19	Section C2 - (i) Southern part of L11 HRSG area and its surrounding at Area E7 except the deferred works for Lube Oil Storage Tank	0 days	01/12/19	01/12/19			
20	Section C2 - (ii) L11 Turbo Block foundation including the L11 MSB ground floor together with the equipment foundations between GL 11-F to 11-H and 11-1 to 11-6 for the installation of power generator, air inlet duct and lube oil reservoir	0 days	30/04/20	30/04/20			
21	Section C2 - (iii) G/F of L11 MSB including the Condenser Pit, Circulating Water Pipe Pit and equipment foundations between GL 11-B to 11-C and 11-1 to 11-6 for the installation of condenser	0 days	01/03/20	01/03/20			
22	Section D - (i) Roads and external grounds surrounding L11 MSB and L11 HRSG in addition to the southern & eastern areas mentioned above in Area E5 and E6	0 days	31/12/19	31/12/19			
23	Section D - (ii) Remaining northern part of L11 HRSG area and its surrounding in Area E6	0 days	01/03/20	01/03/20			
24	Section D - (iii) Whole of L11 MSB including the pipe and cable rack along south façade of L11 MSB with all underground utilities at Area E4 including C.W. Inlet and Outlet Culvert except the deferred works	0 days	30/04/20	30/04/20			
25	Section D - (iv) Link Bridge between L10 and L11 MSB and at the south of L11 MSB including their associated alternations & additions (A&A) Works at L10 MSB	0 days	30/04/20	30/04/20			
26	Section D - (v) Gas Duct Foundation, Pipe and Cable Rack and associated trench in Area E20	0 days	01/02/20	01/02/20			
27	Section E1 - (i) Link Bridge and Pipe and Cable Rack connecting L11 MSB to the western area of L11 MSB at Area E3	0 days	28/09/20	28/09/20			
28	Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station Equipment Room (GRS) Area Extension at Area E16	0 days	30/06/20	30/06/20			
29	Section E1 - (iii) External Works at Area E15 ( C )	0 days	28/02/21	28/02/21			
30	Section E2 - Pipe and Cable Rack and trench at west of Chimney Road and Pipe and Cable Rack at south of Middle Road at Area E8 and E19	0 days	17/09/20	17/09/20			
31	Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B)	0 days	30/06/20	30/06/20			
32	Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A)	0 days	15/09/19	15/09/19			
33	Section F - 275kV Station Building Extension and associated works at Area E17	0 days	30/05/20	30/05/20			
34	Section G - A&A Works at No. 4 C.W. Intake at Area E12	0 days	31/05/20	31/05/20			
35	Section H - L11 Steel flue liner at No. 4 Chimney	0 days	15/07/19	15/07/19			

◆ Section H - L11 Steel flue liner at No. 4 Chimney

ID	Task Name	Duration	Start	Finish	2019		
					Jun 2019	Jul 2019	Aug 2019
36	Section I - (i) 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (B)	0 days	15/05/20	15/05/20			
37	Section I - (ii) Interconnector 2 Trench Modification Works at Area E10	0 days	15/05/20	15/05/20			
38	Section J - (i) Demolition of Retractable Cover A&B & (ii) Foundation of LMX Light Oil Storage Tank Nos. 3 & 4 and A&A for Existing Bund Wall at	0 days	30/04/21	30/04/21			
39	Section K1 - External works at Area 15 ( E ) and 15( F )	0 days	31/05/21	31/05/21			
40	Section K2 - Removal of Southern Bund and External Works at Area D5, D6 and D7	0 days	31/05/21	31/05/21			
41	Section K3 - All remaining works shall be completed for reporting completion to BD and ready for OP inspection	0 days	30/09/21	30/09/21			
42	<b>General &amp; Preliminary</b>	<b>318 days</b>	<b>01/06/18</b>	<b>24/04/19</b>			
43	Set up Temporary Site Office and Utilities	90 days	01/06/18	29/08/18			
44	Permit Applications & Statuary Submissions	120 days	30/08/18	27/12/18			
45	Existing Utilities scanning & Excavation Permit	45 days	13/11/18	27/12/18			
46	Tower Crane erection 2@MSB, 1@ 275	50 days	06/03/19	24/04/19			
47	<b>Submission and Approval</b>	<b>554 days</b>	<b>01/06/18</b>	<b>16/12/19</b>			
48	Method Statement / Temp Work Submission & Approval from HEC for General Works	240 days	01/06/18	26/01/19			
49	BD Approval & Consent (If required)	120 days	01/06/18	28/09/18			
50	BIM Model, CSD & CBWD Submission & Approval from HEC	200 days	29/09/18	26/04/19			
51	Structure Steelwork Connection Design Submission & BD Approval	60 days	29/09/18	27/11/18			
52	Structure Steelwork Shop Drawing & Approval	60 days	13/10/18	11/12/18			
53	Metal Cladding, louvre & windows submission & BD Approval	60 days	28/11/18	26/01/19			
54	Metal Cladding, louvre & windows shop drawing submission	60 days	12/12/18	19/02/19			
55	Order, Off Site Fabrication and Delivery (S. Steel & Cladding & louvres)	180 days	27/10/18	04/05/19			
56	Retractable Cover D BD Submission & Approval	90 days	20/02/19	20/05/19			
57	No. 4 C.W. Outfall A&A BD 1st Submission	90 days	30/08/18	27/11/18			
58	Submission & Approval of Steel Flue Assessment Report and Design Drawings	60 days	30/09/18	28/11/18			
59	Submission and Approval of Steel Flue Design from BD	60 days	30/09/18	28/11/18			
60	Material Fabrication & Delivery for L11 Flue	100 days	15/10/18	22/01/19			
61	Folding Shutters Shop Drawing Submission & Approval	120 days	20/02/19	19/06/19			
62	Fabrication & Delivery of Folding Shutters	150 days	20/06/19	16/11/19			
63	Sewage Pump System Design submission & approval	90 days	22/03/19	19/06/19			
64	Fabrication & Delivery of Sewage Pump	180 days	20/06/19	16/12/19			
65	Other material submission & approval & delivery	300 days	30/08/18	05/07/19			
66	<b>Coordination with the Employer's Specialist Contractors</b>	<b>478 days</b>	<b>20/05/19</b>	<b>19/09/20</b>			
67	Installation of Puddle Pipes at C.W. outlet Culvert	7 days	20/05/19	26/05/19			
68	Installation of Puddle Pipes at C.W. Inlet Culvert	7 days	07/07/19	13/07/19			
69	Template setting at L11 Turbo Block Foundation	60 days	01/01/20	09/03/20			
70	Template setting of holding down bolts at HRSG column base	46 days	23/07/19	06/09/19			
71	I-beam / channel base installation on top of transformer foundations at Transformer Area	30 days	17/04/20	16/05/20			
72	Overhead crane erection at turbine hall using access through a temporary opening at L11 MSB roof between GL11-G to 11-H and 11-2 to 11-6	36 days	01/12/19	07/01/20			
73	Condenser assembly and erection using access through a temporary façade opening at L11 MSB below 1/F along GL 11-6 from GL11-B to 11-C including a clear space below 1/F between GL 11-B to 11-C	127 days	01/03/20	05/07/20			
74	Installation of power train equipment including air inlet duct using access through a temporary façade opening at L11 MSB below 1/F along GL 11-6 from GL11-F to 11-H including a clear space below 1/F of the above area	142 days	01/05/20	19/09/20			
75	Installation of embedded materials such as holding down bolts for equipment foundations - Commencement	30 days	23/06/19	22/07/19			
76	<b>Section A1 &amp; A2 - Ground treatment at Zone 1A &amp; 1B</b>	<b>92 days</b>	<b>01/08/18</b>	<b>31/10/18</b>			
77	Plant establishment for earthworks	7 days	01/08/18	07/08/18			
78	Backfilling and compaction from existing ground +4.5mPD to +5.5mPD	45 days	08/08/18	21/09/18			
79	Delivery of band drain	5 days	29/08/18	02/09/18			
80	Plant establishment for band drain (1st rig)	10 days	03/09/18	12/09/18			
81	Plant establishment for band drain (2nd rig)	7 days	20/09/18	26/09/18			
82	Plant establishment for band drain (3rd rig)	7 days	11/10/18	17/10/18			



ID	Task Name	Duration	Start	Finish	2019			
					Jun 2019	Jul 2019	Aug 2019	
83	Vert. Band drain installation (1023 nos. x 44m)	45 days	13/09/18	27/10/18				
84	Deposition of surcharge up to +8.3mPD	45 days	17/09/18	31/10/18				
85	<b>Section A3 - Ground treatment installation works at Zone 2</b>	<b>158 days</b>	<b>01/10/18</b>	<b>17/03/19</b>				
86	Backfilling and compaction from existing ground +4.5mPD to +5.5mPD	30 days	01/10/18	30/10/18				
87	Delivery of band drain	6 days	18/10/18	23/10/18				
88	Vert. Band drain installation (1787 nos. x 44m)	50 days	24/10/18	12/12/18				
89	Deposition of surcharge up to +8.3mPD	60 days	03/12/18	31/01/19				
90	Additional Concrete Blocks + Extra Surcharge	60 days	07/01/19	17/03/19				
91	<b>Section A4 - Ground treatment installation works at Zone 3</b>	<b>131 days</b>	<b>01/11/18</b>	<b>21/03/19</b>				
92	Backfilling and compaction from existing ground +4.5mPD to +5.5mPD	12 days	01/11/18	12/11/18				
93	Vert. Band drain installation	60 days	09/11/18	07/01/19				
94	Deposition of surcharge up to +8.3mPD	45 days	18/12/18	31/01/19				
95	Possession of Part 1 Defer portion at Zone 3	0 days	20/02/19	20/02/19				
96	Vert. Band drain installation	10 days	20/02/19	01/03/19				
97	Possession of Part 2 Defer portion at Zone 3	0 days	01/03/19	01/03/19				
98	Vert. Band drain installation	7 days	01/03/19	07/03/19				
99	Surcharge at deferred portion	14 days	08/03/19	21/03/19				
100	<b>Section A5 (i) - Ground treatment installation works at Zone 4</b>	<b>83 days</b>	<b>26/12/18</b>	<b>28/03/19</b>				
101	Site Preparation for Vertical Band Drain	3 days	01/01/19	03/01/19				
102	Band drain installation	21 days	26/12/18	15/01/19				
103	Possession of Defer portion at Zone 4	0 days	01/03/19	01/03/19				
104	Vert. Band drain installation	28 days	01/03/19	28/03/19				
105	<b>Section A5 (ii) - Surcharge works at Zone 4</b>	<b>30 days</b>	<b>01/09/20</b>	<b>30/09/20</b>				
106	Deposition of surcharge up to +8.3mPD	30 days	01/09/20	30/09/20				
107	<b>Section A6 (i) - A&amp;A Works for No. 4 C.W. Outfall at Area E18</b>	<b>493 days</b>	<b>01/11/18</b>	<b>28/03/20</b>				
108	BD Amendment, resubmission & approval for Jacking Pit	170 days	01/11/18	29/04/19				
109	Consent for Jacking Pit ELS	28 days	20/04/19	17/05/19				
110	Mobilization	0 days	15/12/18	15/12/18				
111	Jacking Pit Sheetpile Installation (incl. Stop work notice + CNY)	60 days	16/12/18	23/02/19				
112	Protective screen and preventive measure for U9 gas pipeline (VO)	28 days	24/02/19	23/03/19				
113	Provision of temp support for U10 gas pipeline (VO) upon RMA allow access	28 days	14/04/19	11/05/19				
114	ELS of jacking pit	30 days	18/05/19	16/06/19				
115	Pipe Jacking set up & ground strengthening	18 days	17/06/19	04/07/19				
116	Pipe Jacking	90 days	10/09/19	08/12/19				
117	Receiving Pit BD Approval	170 days	25/11/18	23/05/19				
118	Consent for Pipe & Sheet pile	28 days	14/05/19	10/06/19				
119	Receiving Pit Pipe & Sheet pile installation	30 days	11/06/19	10/07/19				
120	Consent for Receiving Pit ELS	28 days	04/07/19	31/07/19				
121	ELS of Receiving pit	40 days	01/08/19	09/09/19				
122	Allow modify existing outfall manhole for pipe jacking receiving	18 days	10/09/19	27/09/19				
123	Culvert Pipe Intallation & water test	55 days	09/12/19	12/02/20				
124	Inspection Manhole at Jacking Pit + backfill (Area E3(A))	18 days	13/02/20	01/03/20				
125	Manhole extension at Outfall no. 4 + backfill + Reinstate of Outfall Rd	45 days	13/02/20	28/03/20				
126	Sheetpile for L12 Outlet culvert (Connection to Jacking Pit)	45 days	15/07/19	28/08/19				
127	Consent + ELS for remaining jacking pit	75 days	29/08/19	11/11/19				
128	Outlet Culvert pipe installation + Thrust Box (remaining portion at A1 Area)	45 days	12/11/19	28/12/19				
129	Sheet pile for future extension along GRS	60 days	29/08/19	27/10/19				
130	<b>Section A6 (ii) - External works at Area E15(D)</b>	<b>37 days</b>	<b>01/01/20</b>	<b>15/02/20</b>				
131	Area possession & Clearance	6 days	01/01/20	06/01/20				
132	Road & Surface Works	31 days	07/01/20	15/02/20				
133	<b>Section B1 (i) - Area south of L11 MSB and HRSG from GL11-F eastwards leading to Chimney Road at Area E1 &amp; E2</b>	<b>375 days</b>	<b>31/01/19</b>	<b>01/03/20</b>				
134	Area Possession & Clearance	0 days	31/01/19	31/01/19				
135	Excavation for CW Inlet Culvert (South of L11 HRSG)	21 days	16/04/19	06/05/19				
136	Installation CW Inlet Culvert pipe	30 days	07/05/19	05/06/19				
137	Construction of Thrust Box & Manholes,etc	14 days	06/06/19	19/06/19				
138	Backfill	21 days	20/06/19	10/07/19				
139	Install underground utilities	45 days	30/09/19	13/11/19				
140	Backfill and Temporary paving for Condensor Move in (E1)	14 days	17/02/20	01/03/20				
141	Backfill and Temporary paving for Condensor Move in (others)	30 days	01/02/20	01/03/20				
142	<b>Section B1 (ii) - Supporting structures for overhead cranes of L11 MSB including the associated roof structure except the roof deferred works</b>	<b>482 days</b>	<b>01/11/18</b>	<b>17/03/20</b>				
143	Area possession & Clearance	0 days	01/11/18	01/11/18				
144	Erection of turbine hall roof except defer work	0 days	13/11/19	13/11/19				

ID	Task Name	Duration	Start	Finish	2019			
					Jun 2019	Jul 2019	Aug 2019	
145	Installation of crane griders	21 days	11/11/19	01/12/19				
146	Turbine hall wall claddings	60 days	09/01/20	17/03/20				
147	<b>Section B1 (iii) - FSRU Civil works at Area E13 (GRS)</b>	<b>151 days</b>	<b>01/01/21</b>	<b>31/05/21</b>				
148	Submission and approval for consent to work	0 days	01/01/21	01/01/21				
149	Civil & Building Works	130 days	01/01/21	10/05/21				
150	Ground reinstatement	21 days	11/05/21	31/05/21				
151	<b>Section B2 - Retractable Cover D at Area E22</b>	<b>435 days</b>	<b>01/01/19</b>	<b>31/03/20</b>				
152	Area Possession, Demolition and clearance work	60 days	01/01/19	11/03/19				
153	Revise Structural Form and BD resubmission & approval	150 days	12/03/19	08/08/19				Revise Structural Form and BD resubmi
154	Foundation construction	60 days	09/08/19	07/10/19				
155	Backfill & Ground reinstatement	30 days	08/10/19	06/11/19				
156	Superstructure fabrication & delivery	90 days	09/08/19	06/11/19				
157	Superstructure erection	90 days	07/11/19	15/02/20				
158	E&M Installation and T&C	45 days	16/02/20	31/03/20				
159	<b>Section B3 - External works at Area B1, D2 and D4</b>	<b>416 days</b>	<b>01/03/19</b>	<b>30/04/20</b>				
160	Receive Area from HKE, Area Possession & Clearance	0 days	01/03/19	01/03/19				
161	Removal of existing paving for band drain under Section A5(i)	30 days	01/03/19	30/03/19				
162	Complete Vert. Band drain under Section A5(i)	0 days	28/03/19	28/03/19				
163	Ground preparation for B1, D2 & D4 for handover to Plant contractor	90 days	01/02/20	30/04/20				
164	<b>Section C1 - Area south of L11 MSB from GL11-F westwards leading to Station Road at Area E3(A) &amp; E3(B)</b>	<b>466 days</b>	<b>01/11/18</b>	<b>01/03/20</b>				
165	Area Possession & Clearance	0 days	01/11/18	01/11/18				
166	Excavation for Type C (Area E3A)	21 days	26/03/19	15/04/19				
167	Installation CW Outlet Culvert Pipe connect to Type C1	21 days	16/04/19	06/05/19				
168	Installation CW Inlet Culvert pipe (South of L11 Condensor)	21 days	20/05/19	09/06/19				
169	Construction of Thrust Box	10 days	10/06/19	19/06/19				
170	Construction of Access Manhole	21 days	10/06/19	30/06/19				
171	Backfill	14 days	01/07/19	14/07/19				
172	Construction of Underground drainage and utilities	60 days	07/11/19	07/01/20				
173	Construct Temp Paving for Condenser move in	45 days	08/01/20	01/03/20				
174	<b>Section C2 - (i) Southern part of L11 HRSG area and its surrounding at Area E7 (No Defer Foundations)</b>	<b>295 days</b>	<b>31/01/19</b>	<b>01/12/19</b>				
175	Area Possession & Clearance	0 days	31/01/19	31/01/19				
176	Excavation & Pile Caps & Tie Beams (HRSG South Area E7)	45 days	19/05/19	02/07/19				
177	Construction RC foundations	45 days	09/07/19	22/08/19				
178	Construction RC plinths	30 days	23/08/19	21/09/19				
179	Construction underground utilities	45 days	23/08/19	06/10/19				
180	Backfill & Construction on-grade slabs	35 days	07/10/19	10/11/19				
181	Backfill and Temporary paving	21 days	11/11/19	01/12/19				
182	<b>Section C2 - (ii) L11 Turbo Block foundation including the L11 MSB ground floor together with the equipment foundations between GL 11-F to 11-H and 11-1 to 11-6 for the installation of power generator, air inlet duct and lube oil reservoir</b>	<b>496 days</b>	<b>01/12/18</b>	<b>30/04/20</b>				
183	Area Possession & Clearance	0 days	01/12/18	01/12/18				
184	Excavation & Pile Caps & Tie Beams (MSBL11 - Turbo Block North)	70 days	14/01/19	03/04/19				
185	Excavation & Pile Caps & Tie Beams (MSBL11 - Turbo Block South)	30 days	10/07/19	08/08/19				
186	Backfill and construction turbine block foundations	21 days	09/08/19	29/08/19				
187	Construction of internal drainage	60 days	09/08/19	07/10/19				
188	Construction RC walls incl. G/F rooms	90 days	08/10/19	07/01/20				
189	Construction turbine block columns and upper portion for plant embed installation	21 days	09/09/19	29/09/19				
190	Concrete Turbine upper part foundation & clear falsework	52 days	10/03/20	30/04/20				
191	<b>Section C2 - (iii) G/F of L11 MSB including the Condenser Pit, Circulating Water Pipe Pit and equipment foundations between GL 11-B to 11-C and 11-1 to 11-6 for the installation of condenser</b>	<b>466 days</b>	<b>01/11/18</b>	<b>01/03/20</b>				
192	Area Possession & Clearance	0 days	01/11/18	01/11/18				
193	Excavation to foundation level at ELS Type A	18 days	13/04/19	30/04/19				
194	Construction of CW Outlet Box + lowest tie beam & caps	40 days	01/05/19	09/06/19				
195	Construction of pile caps & tie beams & hot well sump pit up to +2.5mPD	30 days	10/06/19	09/07/19				
196	Backfill & Construction of CW Inlet Box + tie beams	18 days	10/07/19	27/07/19				
197	Backfill and Construction ground beams & trenches	18 days	28/07/19	14/08/19				

ID	Task Name	Duration	Start	Finish	2019			
					Jun 2019	Jul 2019	Aug 2019	
198	Construction of indoor underground drainage	12 days	15/08/19	26/08/19				
199	Backfill & construction on-grade slabs	10 days	27/08/19	05/09/19				
200	Construction Column casting and RC walls	30 days	30/09/19	29/10/19				
201	Metal Cladding & Louvres for GLB-C/1-6	60 days	28/11/19	06/02/20				
202	Mis. Works for plant erection	24 days	07/02/20	01/03/20				
203	<b>Section D - (i) Roads and external grounds surrounding L11 MSB and L11 HRSG in addition to the southern &amp; eastern areas mentioned above in Area E5 and E6</b>	<b>414 days</b>	<b>01/11/18</b>	<b>31/12/19</b>	c.D(i)			
204	Area Possession & Clearance	14 days	01/11/18	14/11/18				
205	Excavation for Type C1 and open sheet pile	75 days	14/01/19	08/04/19				
206	Install CW Outlet pipe & connect to previous	21 days	16/04/19	06/05/19				
207	Backfill	10 days	07/05/19	16/05/19				
208	Undeground utilities and trenches	60 days	03/07/19	31/08/19				
209	Construction of plant drainage, trenches & RC plinths	45 days	01/09/19	15/10/19				
210	Remaining Undeground utilities & backfill (West of Tx Bay)	75 days	16/10/19	31/12/19				
211	<b>Section D - (ii) Remaining northern part of L11 HRSG area and its surrounding in Area E6</b>	<b>375 days</b>	<b>31/01/19</b>	<b>01/03/20</b>	c.D(ii)			
212	Area Possession & Clearance	0 days	31/01/19	31/01/19				
213	Excavation & Pits & Pile Caps & Tie Beams (HRSG north Area E6)	45 days	04/04/19	18/05/19				
214	Construction RC foundations	45 days	19/05/19	02/07/19				
215	Construction RC plinths & HRSG Lift Pit & internal drainage	60 days	09/06/19	07/08/19				
216	Backfill Construction on-grade slabs	28 days	08/08/19	04/09/19				
217	Construction underground utilities	45 days	05/09/19	19/10/19				
218	Backfill, Remaining utilities and temporary paving	85 days	14/11/19	17/02/20				
219	Touch up and site clearance	13 days	18/02/20	01/03/20				
220	<b>Section D - (iii) Whole of L11 MSB including the pipe and cable rack along south facade of L11 MSB with all underground utilities at Area E4 including C.W. Inlet and Outlet Culvert except the deferred works</b>	<b>526 days</b>	<b>01/11/18</b>	<b>30/04/20</b>	c.D(iii)			
221	Area Possession & Clearance	0 days	01/11/18	01/11/18				
222	Construction of pile caps & tie beams at Transformer Area	60 days	15/11/18	13/01/19				
223	Excavation & Construction Blow Down Sum pit (Type B)	45 days	04/04/19	18/05/19				
224	Construction of pile caps & tie beams at SunShadeCover Area	45 days	10/07/19	23/08/19				
225	Preparation for S.Steelwork Erection	14 days	03/07/19	16/07/19				
226	Structural Delivery & Erection (Turhine Hall North fr G.L. 1-3/H->B)	30 days	17/07/19	15/08/19				
227	Structural Delivery & Erection (Equipment Floors)	45 days	16/08/19	29/09/19				
228	Structural Delivery & Erection (Turbine Hall South)	45 days	30/09/19	13/11/19				
229	Fire Coating Application at Joint	120 days	16/08/19	13/12/19				
230	External Scaffolding Erection	150 days	31/07/19	29/12/19				
231	Construction 1/F RC Slab	14 days	30/09/19	13/10/19				
232	Construction M/F RC Slab	7 days	14/10/19	20/10/19				
233	Construction 2/F RC Slab	14 days	14/10/19	27/10/19				
234	Construction 3/F RC Slab	14 days	28/10/19	10/11/19				
235	Construction 4/F RC Slab	14 days	11/11/19	24/11/19				
236	Construction 5/F RC Slab (Roof of turbine hall, except defer portion)	30 days	25/11/19	24/12/19				
237	Construction Roof RC Slab	14 days	09/12/19	22/12/19				
238	Construction Upper Roof RC Slab	12 days	27/12/19	07/01/20				
239	Construction Defer Roof RC Slab (G.L. G-H)	30 days	08/01/20	15/02/20				
240	Construction of Staircase ST-01 & lift shaft & machine room	120 days	30/08/19	29/12/19				
241	Construction of Staircase ST-02 except defer work	76 days	28/10/19	13/01/20				
242	Construction of RC plinth, kerbs & parapet Walls	30 days	07/02/20	07/03/20				
243	Erection of Skylight & Roof Features	45 days	21/02/20	05/04/20				
244	Waterproofing & Flooring at Roof	60 days	08/01/20	16/03/20				
245	ABFW Works from 1/F to 5/F equipment rooms	150 days	21/10/19	29/03/20				
246	Metal Cladding, Windows and Louvres incl. roof feature	100 days	28/11/19	17/03/20				
247	Removal of external scaffolding	60 days	17/02/20	16/04/20				
248	Building Services E&M Access & Installation	150 days	04/11/19	12/04/20				
249	Remaining and Mis. works for Plant erection Full Access	18 days	13/04/20	30/04/20				
250	<b>Section D - (iv) Link Bridge between L10 and L11 MSB and at the south of L11 MSB including their associated alternations &amp; additions (A&amp;A) Works at L10 MSB</b>	<b>526 days</b>	<b>01/11/18</b>	<b>30/04/20</b>	c.D(iv)			
251	Area Possession & Clearance	0 days	01/11/18	01/11/18				



ID	Task Name	Duration	Start	Finish	2019		
					Jun 2019	Jul 2019	Aug 2019
252	A&A works at South of L10 MSB	60 days	28/11/19	07/02/20			
253	Erection of link bridge structural steel	21 days	07/02/20	27/02/20			
254	Casting of bridge deck	7 days	28/02/20	05/03/20			
255	Metal roofing installation	14 days	06/03/20	19/03/20			
256	ABWF work	21 days	20/03/20	09/04/20			
257	Form new opening at MSB for final connection	14 days	27/03/20	09/04/20			
258	E&M Work for completion	21 days	10/04/20	30/04/20			
259	<b>Section D - (v) Gas Duct Foundation, Pipe and Cable Rack and associated trench in Area E20</b>	<b>345 days</b>	<b>11/02/19</b>	<b>01/02/20</b>	c.D(v)		
260	Area Possession & Clearance + CNY	0 days	11/02/19	11/02/19			
261	Sheet pile installation & submit as-built	75 days	11/02/19	26/04/19			
262	Consent for excavation	28 days	27/04/19	24/05/19			
263	Excavation & plate load test	45 days	01/06/19	15/07/19	excavation		
264	Construction of foundation	45 days	16/07/19	29/08/19		Excavation & plate load test	
265	Backfill & Underground utilities	30 days	30/08/19	28/09/19			
266	Remaining Pipe & cable rack and associated trenches in Area E20	115 days	29/09/19	01/02/20			
267	<b>Section E1 - (i) Link Bridge and Pipe and Cable Rack connecting L11 MSB to the western area of L11 MSB at Area E3</b>	<b>263 days</b>	<b>01/01/20</b>	<b>28/09/20</b>			
268	Area Possession	0 days	01/01/20	01/01/20			
269	Excavation & construction of new foundation	40 days	01/01/20	18/02/20			
270	Backfill	10 days	19/02/20	28/02/20			
271	Erection of Structural steel	30 days	06/07/20	04/08/20			
272	Backfill & Ground works	55 days	05/08/20	28/09/20			
273	<b>Section E1 - (ii) Gas Receiving Station and L11 Gas Receiving Station Equipment Room (GRS) Area Extension at Area E16</b>	<b>173 days</b>	<b>01/01/20</b>	<b>30/06/20</b>			
274	Area Possession	0 days	01/01/20	01/01/20			
275	Removal of Surcharge and excavation	14 days	01/01/20	14/01/20			
276	Modification of Site Drainage	45 days	15/01/20	08/03/20			
277	Construction of new RC for GRS Equipment Room	75 days	14/01/20	06/04/20			
278	ABWF for GRS Equipment room	45 days	07/04/20	21/05/20			
279	E&M Installation	45 days	17/05/20	30/06/20			
280	Construction of new Gas pipe plinths & racks	45 days	22/02/20	06/04/20			
281	Backfill and construction site drainage	21 days	07/04/20	27/04/20			
282	External Paving and install new fencing	60 days	02/05/20	30/06/20			
283	<b>Section E1 - (iii) External Works at Area E15 ( C )</b>	<b>273 days</b>	<b>01/06/20</b>	<b>28/02/21</b>			
284	Removal of Surcharge and excavation	45 days	01/06/20	15/07/20			
285	Underground drianage, Utilities and RC plinths	123 days	16/07/20	15/11/20			
286	Backfill and install surface utilities	45 days	16/11/20	30/12/20			
287	Roadwork	60 days	31/12/20	28/02/21			
288	<b>Section E2 - Pipe and Cable Rack and trench at west of Chimney Road and Pipe and Cable Rack at south of Middle Road at Area E8 and E19</b>	<b>495 days</b>	<b>01/05/19</b>	<b>17/09/20</b>			
289	BD consent + Site Possession @ Area E8	0 days	01/05/19	01/05/19			
290	Excavation & Plate load test	60 days	01/05/19	29/06/19	Excavation & Plate load test		
291	Foundation and Trench constructions	90 days	30/06/19	27/09/19			
292	Backfill & underground utitiles + temp paving	60 days	28/09/19	26/11/19			
293	Excavation & plate load test @ E19	60 days	27/11/19	05/02/20			
294	Construction of foundations & trenches	45 days	06/02/20	21/03/20			
295	Backfill & underground utitiles	60 days	22/03/20	20/05/20			
296	Pipe & cable rack Erection	60 days	21/05/20	19/07/20			
297	Ground reinstatement	60 days	20/07/20	17/09/20			
298	<b>Section E3 - Gas Pipe Support Foundation and Pipe Trench and associated external works at Area E14, E15 (A) and E15 (B)</b>	<b>173 days</b>	<b>01/01/20</b>	<b>30/06/20</b>			
299	Removal of surcharge / site clearance	21 days	01/01/20	21/01/20			
300	Excavation & construction of pipe trench	30 days	22/01/20	29/02/20			
301	Construction of gas pipe support foundation	30 days	01/03/20	30/03/20			
302	Construction of underground drainage and utilities	60 days	31/03/20	29/05/20			
303	Backfill & road work	32 days	30/05/20	30/06/20			
304	<b>Section E4 - 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (A)</b>	<b>185 days</b>	<b>15/03/19</b>	<b>15/09/19</b>			
305	Site possession	0 days	15/03/19	15/03/19			
306	Obtain Permit to work & Road close permit	10 days	15/03/19	24/03/19			

ID	Task Name	Duration	Start	Finish	2019		
					Jun 2019	Jul 2019	Aug 2019
307	Excavation & construction new cable trench to 275kV	45 days	25/03/19	08/05/19	Trench to 275kV		
308	Excavation & construction new cable trench to L11MSB	130 days	09/05/19	15/09/19			
309	<b>Section F - 275kV Station Building Extension and associated works at Area E17</b>	<b>709 days</b>	<b>01/06/18</b>	<b>30/05/20</b>	c.F		
310	Installation of ELS for 275kV Switching Station near Staircase ST-3 and ST-6	14 days	01/06/18	14/06/18			
311	Construction of Staircase ST-3	110 days	15/06/18	02/10/18			
312	BD Amendment Approval on A&A	0 days	17/12/18	17/12/18			
313	BD Amendment Approval on A&A ST3 & Drainage	0 days	04/02/19	04/02/19			
314	OP inspection of Staircase ST-3	14 days	11/02/19	24/02/19			
315	Consent of New Foundation Works (Stage 1)	0 days	19/10/18	19/10/18			
316	Consent & BA10 for Demolition of Existing Staircase	0 days	08/03/19	08/03/19			
317	Demolition of Existing Staircase and Submit BA14A	14 days	09/03/19	22/03/19			
318	BD inspection for BA14A & Issue OP	28 days	23/03/19	19/04/19			
319	Consent & BA10 for New Foundation Work (Stage 2)	28 days	13/04/19	10/05/19	Work (Stage 2)		
320	Hoarding Modification	7 days	19/10/18	25/10/18			
321	Pile Cap & Tie Beam Construction (Stage 1)	98 days	26/10/18	31/01/19			
322	Erection of Tower Crane	40 days	11/02/19	22/03/19			
323	Pile Cap and Tie Beam (Stage 2)	21 days	11/05/19	31/05/19	Pile Cap and Tie Beam (Stage 2)		
324	RC Construction up to 1/F (Stage 1)	30 days	11/05/19	09/06/19	RC Construction up to 1/F (Stage 1)		
325	RC Construction up to 1/F (Stage 2)	75 days	01/06/19	14/08/19	RC Construction up to 1/F (Stage 2)		
326	Construction of Staircase ST6	90 days	15/09/19	13/12/19			
327	Shop Drawing Submission & Approval of Structural Steel	45 days	27/02/19	12/04/19			
328	Structural Steel fabrication & Delivery	60 days	13/04/19	11/06/19	Structural Steel fabrication & Delivery		
329	Erection of Structural Steel GL 17~18	30 days	16/08/19	14/09/19			
330	Erection of Structural Steel GL 8~17	60 days	15/09/19	13/11/19			
331	Metal Cladding Delivery	60 days	07/08/19	05/10/19			
332	Metal Door, Window & Louvre Delivery	45 days	06/10/19	19/11/19			
333	Erection of Working Platform and Scaffold	150 days	01/07/19	27/11/19			
334	Install Decking	60 days	09/10/19	07/12/19			
335	RC Walls from 1/F @ GIS Hall	40 days	31/10/19	09/12/19			
336	Construction of 2/F RC slab	14 days	10/12/19	23/12/19			
337	Construction of R/F RC slab	21 days	24/12/19	15/01/20			
338	Construction of UR/F RC slab	14 days	16/01/20	07/02/20			
339	Construction of GIS Hall Floor	60 days	24/12/19	03/03/20			
340	Installation of Overhead Crane (By JEC)	60 days	04/03/20	02/05/20			
341	Construction of staircase ST4, ST5, Lift Shaft & Equip Floors	150 days	15/09/19	22/02/20			
342	Lift Installation	90 days	23/02/20	22/05/20			
343	Concrete of RC walls, plinths, kerb & parapet walls & New trench for LV Power	30 days	24/12/19	02/02/20			
344	ABWF Works @ G/F	50 days	14/10/19	02/12/19			
345	ABWF Works @ 1/F	50 days	13/11/19	03/01/20			
346	ABWF Works @ 2/F	75 days	13/12/19	07/03/20			
347	ABWF Works @ R/F	30 days	14/01/20	21/02/20			
348	ABWF Works @ UR/F	21 days	03/02/20	23/02/20			
349	Waterproofing Works at R/F & UR/F	45 days	16/01/20	09/03/20			
350	Building Services E&M Access & Installation & T&C	150 days	13/11/19	21/04/20			
351	Metal Cladding, Windows and Louvres incl. Roof Feature	90 days	24/12/19	02/04/20			
352	Shutter Erection	30 days	03/04/20	02/05/20			
353	Removal of External Scaffolding + Tower Crane	35 days	03/04/20	07/05/20			
354	External Underground Drainage and Utilities	30 days	17/04/20	16/05/20			
355	Road & Paving Reinstatement	30 days	01/05/20	30/05/20			
356	Ready for FSD & OP Inspection	0 days	30/05/20	30/05/20			
357	<b>Section G - A&amp;A Works at No. 4 C.W. Intake at Area E12</b>	<b>143 days</b>	<b>01/01/20</b>	<b>31/05/20</b>			
358	Permit to work	0 days	01/01/20	01/01/20			
359	Erection of temp. platform	14 days	01/01/20	14/01/20			
360	Demolition work	30 days	15/01/20	22/02/20			
361	Modify existing slab openings	75 days	23/02/20	07/05/20			
362	Curing + Removal of platform	24 days	08/05/20	31/05/20			
363	<b>Section H - L11 Steel flue liner at No. 4 Chimney</b>	<b>186 days</b>	<b>01/01/19</b>	<b>15/07/19</b>	c.H		
364	Complete erection of L10 Steel flue	0 days	01/01/19	01/01/19			
365	Modification of erection equipment	21 days	01/01/19	21/01/19			
366	Erection temp. platform and demolition work	30 days	22/01/19	02/03/19			
367	Structural steel delivery & Erection	85 days	03/03/19	26/05/19	Structural steel delivery & Erection		
368	Removal of temp. work	5 days	27/05/19	31/05/19	Removal of temp. work		
369	Reinstate G/F louvre wall and access door	45 days	01/06/19	15/07/19	Reinstate G/F louvre wall and access door		
370	<b>Section I - (i) 275kV cable trenching works connecting the 275kV Switching Station Extension and L11 MSB at Area E9 (B)</b>	<b>232 days</b>	<b>15/09/19</b>	<b>15/05/20</b>			
371	Obtain Permit to work & Road close permit	0 days	15/09/19	15/09/19			
372	Excavation & construction new cable trench	160 days	16/09/19	04/03/20			
373	Re-excavate cable trench for cable laying	72 days	05/03/20	15/05/20			
374	<b>Section I - (ii) Interconnector 2 Trench Modification Works at Area E10</b>	<b>275 days</b>	<b>01/04/20</b>	<b>31/12/20</b>			
375	Obtain Permit to work & Road close permit	0 days	01/04/20	01/04/20			
376	Re-excavate & new cable trench for cable laying	275 days	01/04/20	31/12/20			

ID	Task Name	Duration	Start	Finish	2019		
					Jun 2019	Jul 2019	Aug 2019
377	<b>Section J - (i) Demolition of Retractable Cover A&amp;B &amp; (ii) Construction of new LOT 3 &amp; 4</b>	<b>426 days</b>	<b>01/03/20</b>	<b>30/04/21</b>			
378	Obtain permit to work & Road close permit	0 days	01/03/20	01/03/20			
379	Erection of Hoarding	21 days	01/03/20	21/03/20			
380	Removal of existing cover & structural steel	30 days	22/03/20	20/04/20			
381	Demolish of existing bund wall and staircases	45 days	21/04/20	04/06/20			
382	Demolish of existing slab & foundation	60 days	05/06/20	03/08/20			
383	Consent for new work	30 days	04/08/20	02/09/20			
384	Construction of new bund wall and foundation	100 days	03/09/20	11/12/20			
385	Construction of new oil separator	80 days	23/09/20	11/12/20			
386	Construct underground drainage and surface channel	40 days	12/12/20	20/01/21			
387	Construction on-grade slab	60 days	21/01/21	21/03/21			
388	Removal of hoarding and ground reinstatement	40 days	22/03/21	30/04/21			
389	<b>Section K1 - External works at Area 15 ( E ) and 15( F )</b>	<b>365 days</b>	<b>01/06/20</b>	<b>31/05/21</b>			
390	Removal of surcharge	30 days	01/06/20	30/06/20			
391	Construct new drainage and utilities work	200 days	01/07/20	16/01/21			
392	Road & Paving	135 days	17/01/21	31/05/21			
393	<b>Section K2 - Removal of Southern Bund and External Works at Area D5, D6 and D7</b>	<b>365 days</b>	<b>01/06/20</b>	<b>31/05/21</b>			
394	Demolition work	30 days	01/06/20	30/06/20			
395	Construct new drainage and utilities work	200 days	01/07/20	16/01/21			
396	Road & Paving	135 days	17/01/21	31/05/21			
397	<b>Section K3 - All remaining works shall be completed for reporting completion to BD and ready for OP inspection (PS1.4.4)</b>	<b>623 days</b>	<b>08/01/20</b>	<b>30/09/21</b>			
398	Completion of remaining roof after over headcrane move in	30 days	08/01/20	15/02/20			
399	Construction of G/F Lube Oil Tank Room (BY TDK)	61 days	06/10/20	05/12/20			
400	Construction of wall and staircase at G/F after Condensor Move in	90 days	06/07/20	03/10/20			
401	Construction of Durasteel Steel wall panel after IBP installation	30 days	20/09/20	19/10/20			
402	Construction of Transformer fence wall, cladding & associated FS services	122 days	01/09/20	31/12/20			
403	Final restatement of road & paving around MSB & HRSG	122 days	01/09/20	31/12/20			
404	Installation of trench covers and gratings after plant installation	151 days	01/10/20	28/02/21			
405	Backfill and reinstatement after 275kV cable laying	122 days	01/06/21	30/09/21			

**Master Programme**

ID	Task Name	Duration	Start	Finish	2019年			2020年		
					M5 六月	M6 七月	M7 八月			
1	<b>Key Date</b>	<b>416 days</b>	<b>3月12日星期二</b>	<b>4月30日星期四</b>						
2	Commencement date	0 days	3月12日星期二	3月12日星期二						
3	Duration of works	416 days	3月12日星期二	4月30日星期四						
4	Site possession date	0 days	3月12日星期二	3月12日星期二						
5	Completion of the Contract	0 days	4月30日星期四	4月30日星期四						
6										
7	<b>Total Contract Period</b>	<b>455 days</b>	<b>2月1日星期五</b>	<b>4月30日星期四</b>						
8										
9	<b>Preliminaries</b>	<b>21 days</b>	<b>3月12日星期二</b>	<b>4月1日星期一</b>						
10	Coordination with utility companies	14 days	3月12日星期二	3月25日星期一						
11	Pre-construction condition survey	14 days	3月12日星期二	3月25日星期一						
12	Notification of commencement of works to Labour Department	7 days	3月12日星期二	3月18日星期一						
13	Notification of air pollution control for commencement of works to EPD	7 days	3月12日星期二	3月18日星期一						
14	Application of water discharge licence from EPD	7 days	3月12日星期二	3月18日星期一						
15	Application for billing account for disposal of construction waste from EPD	7 days	3月12日星期二	3月18日星期一						
16	CCTV for existing underground drainage pipe around site boundary	21 days	3月12日星期二	4月1日星期一						
17	Utility detection for existing underground cables	21 days	3月12日星期二	4月1日星期一						
18	Site clearance	21 days	3月12日星期二	4月1日星期一						
19	Set up contractor's site office	21 days	3月12日星期二	4月1日星期一						
20	Installation of monitoring checkpoints	20 days	3月12日星期二	3月31日星期日						
21	Submission of BA10 for ELS & foundation works	7 days	3月12日星期二	3月18日星期一						
22										
23	<b>Predrilling Works for Section of A1 to A3 (Area P1 to P3)</b>	<b>96 days</b>	<b>2月1日星期五</b>	<b>5月7日星期二</b>						
24	Drilling rigs mobilization	10 days	2月1日星期五	2月10日星期日						
25	Predrilling works (46 holes) (8 rigs)	81 days	2月11日星期一	5月2日星期四						
26	Submission of predrill logs	71 days	2月26日星期二	5月7日星期二						
27	Completion of predrilling works	0 days	5月7日星期二	5月7日星期二						
28										
29	<b>Plant Mobilization for Bored Pile Construction</b>	<b>150 days</b>	<b>3月19日星期二</b>	<b>8月15日星期四</b>						
30	<b>Crawler Crane</b>	<b>136 days</b>	<b>3月19日星期二</b>	<b>8月1日星期四</b>						
31	1st & 2nd set	21 days	3月19日星期二	4月8日星期一						
32	3rd set	21 days	4月10日星期三	4月30日星期二						
33	4th & 5th set	21 days	6月14日星期五	7月4日星期四						
34	6th set	21 days	7月12日星期五	8月1日星期四						
35	<b>Oscillator</b>	<b>136 days</b>	<b>3月19日星期二</b>	<b>8月1日星期四</b>						
36	1st & 2nd set	21 days	3月19日星期二	4月8日星期一						
37	3rd set	21 days	4月10日星期三	4月30日星期二						
38	4th & 5th set	21 days	6月14日星期五	7月4日星期四						
39	6th set	21 days	7月12日星期五	8月1日星期四						
40	<b>RCD</b>	<b>129 days</b>	<b>4月9日星期二</b>	<b>8月15日星期四</b>						
41	1st & 2nd set	14 days	4月9日星期二	4月22日星期一						
42	3rd set	14 days	5月1日星期三	5月14日星期二						
43	4th & 5th set	14 days	7月5日星期五	7月18日星期四						
44	6th set	14 days	8月2日星期五	8月15日星期四						
45	Completion of plant mobilization for bored pile construction	0 days	8月15日星期四	8月15日星期四						
46										
47	<b>Delivery of Temporary Steel Casing for Bored Pile Construction</b>	<b>150 days</b>	<b>3月19日星期二</b>	<b>8月15日星期四</b>						
48	Duration for delivery of temporary steel casing	150 days	3月19日星期二	8月15日星期四						
49	Completion of delivery of temporary steel casing for bored pile construction	0 days	8月15日星期四	8月15日星期四						
50										
51	<b>Delivery of Permanent Casing &amp; Double Wall Liner</b>	<b>369 days</b>	<b>3月18日星期一</b>	<b>3月20日星期五</b>						
52	Testing for double wall liner	45 days	3月18日星期一	5月1日星期三						
53	Duration for delivery of permanent casing & double wall liner	325 days	5月1日星期三	3月20日星期五						
54										
55	<b>Section A1</b>	<b>320 days</b>	<b>3月18日星期一</b>	<b>1月31日星期五</b>						

Master Programme      Task Critical Task Milestone Summary

**Master Programme**

ID	Task Name	Duration	Start	Finish	2019年			2020年		
						M5 六月	M6 七月	M7 八月		
56	<b>Bored Pile Construction at P1 (17 piles)</b>	<b>296 days</b>	<b>4月11日 星期四</b>	<b>1月31日 星期五</b>						
57	1st set plant - BP13 > BP5 > BP9 > BP26 > BP1 > BP12 > BP8 > BP4 > G2 > G4 > G6	273 days	4月11日 星期四	1月8日 星期三						
58	3rd set plant - G8	45 days	4月22日 星期一	6月5日 星期三						
59	3rd set plant - BPC3 > BPC4 > BPC5 > BPC6 > BPC7	135 days	8月30日 星期五	1月11日 星期六						
60	Interface & sonic test	28 days	1月4日 星期六	1月31日 星期五						
61	Completion of bored pile construction at P1	0 days	1月31日 星期五	1月31日 星期五						
62										
63	<b>Sheet Pile at P1</b>	<b>215 days</b>	<b>7月1日 星期一</b>	<b>1月31日 星期五</b>						
64	Delivery of sheet pile material	14 days	7月1日 星期一	7月14日 星期日						
65	Installation of sheet pile (approx. 57 piles) (1 rig)	10 days	7月17日 星期三	7月26日 星期五						
66	Installation of sheet pile (approx. 254 piles) (1 rig)	38 days	12月17日 星期二	1月23日 星期四						
67	Prepare & submit as-built record plan	7 days	1月24日 星期五	1月30日 星期四						
68	Submission of BA14	1 day	1月31日 星期五	1月31日 星期五						
69	Completion of sheet pile at P1	0 days	1月31日 星期五	1月31日 星期五						
70										
71	<b>Cone Penetration Test</b>	<b>104 days</b>	<b>3月18日 星期一</b>	<b>6月29日 星期六</b>						
72	Plant mobilization	14 days	3月18日 星期一	3月31日 星期日						
73	Carry out CPTU testing (9 nos.) (1 rig)	90 days	4月1日 星期一	6月29日 星期六						
74	Completion of cone penetration test	0 days	6月29日 星期六	6月29日 星期六						
75	Completion of section A1	0 days	1月31日 星期五	1月31日 星期五						
76										
77	<b>Section A2</b>	<b>197 days</b>	<b>4月8日 星期一</b>	<b>10月21日 星期一</b>						
78	<b>Bored Pile Construction at P2 (11 piles)</b>	<b>197 days</b>	<b>4月8日 星期一</b>	<b>10月21日 星期一</b>						
79	2nd set plant - BP27 > BP24 > BP23 > BP16 > BP20 > BP17	161 days	4月8日 星期一	9月15日 星期日						
80	3rd set plant - G10 > BP21 > BPC8 > BPC1 > BPC2	135 days	5月12日 星期日	9月23日 星期一						
81	Interface & sonic test	28 days	9月24日 星期二	10月21日 星期一						
82	Completion of bored pile construction at P2	0 days	10月21日 星期一	10月21日 星期一						
83	Completion of section A2	0 days	10月21日 星期一	10月21日 星期一						
84										
85	<b>Section A3</b>	<b>331 days</b>	<b>5月18日 星期六</b>	<b>4月12日 星期日</b>						
86	<b>Bored Pile Construction at P3 (18 piles)</b>	<b>283 days</b>	<b>7月5日 星期五</b>	<b>4月12日 星期日</b>						
87	4th set plant - G1 > G3 > G5 > G7 > G9	225 days	7月5日 星期五	2月14日 星期五						
88	5th set plant - BP15 > BP19 > BP22 > BP25 > BP28	225 days	7月5日 星期五	2月14日 星期五						
89	6th set plant - BP3 > BP6 > BP7 > BP11 > BP2 > BP10 > BP14 > BP18	203 days	8月2日 星期五	2月20日 星期四						
90	Interface & sonic test	28 days	2月21日 星期五	3月19日 星期四						
91	Prepare & submit as-built record plan	7 days	3月13日 星期五	3月19日 星期四						
92	Submission of BA14	1 day	3月19日 星期四	3月19日 星期四						
93	Allow 14 days for selection of pile for concrete full core test	14 days	3月20日 星期五	4月2日 星期四						
94	Concrete full core test	10 days	4月3日 星期五	4月12日 星期日						
95	Completion of bored pile construction at P3	0 days	4月12日 星期日	4月12日 星期日						
96										
97	<b>Sheet Pile at P3</b>	<b>60 days</b>	<b>5月18日 星期六</b>	<b>7月16日 星期二</b>						
98	Plant mobilization	7 days	5月25日 星期六	5月31日 星期五						
99	Delivery of sheet pile material	14 days	5月18日 星期六	5月31日 星期五						
100	Installation of sheet pile (approx. 626 piles) (2 rigs)	46 days	6月1日 星期六	7月16日 星期二						
101	Completion of sheet pile at P3	0 days	7月16日 星期二	7月16日 星期二						
102	Completion of section A3	0 days	4月12日 星期日	4月12日 星期日						
103										
104	<b>Section B</b>	<b>305 days</b>	<b>7月1日 星期一</b>	<b>4月30日 星期四</b>						
105	<b>Shunt Reactor</b>	<b>121 days</b>	<b>1月1日 星期三</b>	<b>4月30日 星期四</b>						
106	Site possession date	0 days	1月1日 星期三	1月1日 星期三						
107	<b>Predrilling Works for Bored Pile</b>	<b>34 days</b>	<b>1月1日 星期三</b>	<b>2月3日 星期一</b>						
108	Drilling rigs mobilization	7 days	1月1日 星期三	1月7日 星期二						
109	Predrilling works (4 holes) (2 rigs)	25 days	1月8日 星期三	2月1日 星期六						
110	Submission of predrill logs	15 days	1月20日 星期一	2月3日 星期一						

Master Programme

Task  Critical Task  Milestone  Summary 



**Master Programme**

ID	Task Name	Duration	Start	Finish	2019年			2020年		
					M5 六月	M6 七月	M7 八月			
111	Completion of predrilling works	0 days	2月3日 星期一	2月3日 星期一						
112										
113	<b>Bored Pile Construction (4 piles)</b>	<b>113 days</b>	<b>1月9日 星期四</b>	<b>4月30日 星期四</b>						
114	Plant mobilization	15 days	1月9日 星期四	1月23日 星期四						
115	1st set plant - BPR-B4 > BPR-E2	65 days	1月16日 星期四	3月20日 星期五						
116	3rd set plant - BPR-E6 > BPR-E5	65 days	1月24日 星期五	3月28日 星期六						
117	Interface & sonic test	14 days	3月24日 星期二	4月6日 星期一						
118	Prepare & submit as-built record plan	7 days	3月31日 星期二	4月6日 星期一						
119	Submission of BA14	1 day	4月6日 星期一	4月6日 星期一						
120	Allow 14 days for selection of pile for concrete full core test	14 days	4月7日 星期二	4月20日 星期一						
121	Concrete full core test	10 days	4月21日 星期二	4月30日 星期四						
122	Completion of bored pile construction	0 days	4月30日 星期四	4月30日 星期四						
123	Completion of shunt reactor	0 days	4月30日 星期四	4月30日 星期四						
124										
125	<b>Cable Bridge</b>	<b>267 days</b>	<b>7月1日 星期一</b>	<b>3月23日 星期一</b>						
126	Site possession date	0 days	7月1日 星期一	7月1日 星期一						
127	<b>Predrilling Works for Bored Pile</b>	<b>55 days</b>	<b>7月1日 星期一</b>	<b>8月24日 星期六</b>						
128	Drilling rigs mobilization	7 days	7月1日 星期一	7月7日 星期日						
129	Predrilling works (8 holes) (2 rig)	46 days	7月8日 星期一	8月22日 星期四						
130	Submission of predrill logs	30 days	7月26日 星期五	8月24日 星期六						
131	Completion of predrilling works	0 days	8月24日 星期六	8月24日 星期六						
132										
133	<b>Bored Pile Construction (6 piles)</b>	<b>178 days</b>	<b>9月16日 星期一</b>	<b>3月11日 星期三</b>						
134	Plant mobilization	14 days	9月16日 星期一	9月29日 星期日						
135	2nd set plant - CP6-1 > CP6-3 > CP6-6 > CP6-8 > CP6-5 > CP6-2 > CP6-7 > CP6-4	150 days	9月30日 星期一	2月26日 星期三						
136	Interface & sonic test	14 days	2月27日 星期四	3月11日 星期三						
137	Completion of bored pile construction	0 days	3月11日 星期三	3月11日 星期三						
138										
139	<b>Temporary Working Platform for Socketted H-Pile Construction</b>	<b>74 days</b>	<b>7月1日 星期一</b>	<b>9月12日 星期四</b>						
140	Material delivery for temporary working platform erection	14 days	7月1日 星期一	7月14日 星期日						
141	Erection of temporary working platform	60 days	7月15日 星期一	9月12日 星期四						
142	Completion of temporary working platform	0 days	9月12日 星期四	9月12日 星期四						
143										
144	<b>Predrilling Works for Socketted H-pile</b>	<b>27 days</b>	<b>9月13日 星期五</b>	<b>10月9日 星期三</b>						
145	Drilling rigs mobilization	7 days	9月13日 星期五	9月19日 星期四						
146	Predrilling works (6 holes) (2 rigs)	18 days	9月20日 星期五	10月7日 星期一						
147	Submission of predrill logs	13 days	9月27日 星期五	10月9日 星期三						
148	Completion of predrilling works	0 days	10月9日 星期三	10月9日 星期三						
149										
150	<b>Socketted H-Pile Construction (30 piles)</b>	<b>168 days</b>	<b>10月8日 星期二</b>	<b>3月23日 星期一</b>						
151	Plant mobilization	14 days	10月8日 星期二	10月21日 星期一						
152	Trial pile installation (1 pile)	14 days	10月22日 星期二	11月4日 星期一						
153	Socketted H-pile installation (16 piles) (1 set plant)	65 days	11月5日 星期二	1月8日 星期三						
154	Post drill	5 days	1月9日 星期四	1月13日 星期一						
155	Prepare & submit as-built record plan	28 days	1月9日 星期四	2月5日 星期三						
156	Submission of BA14	1 day	2月6日 星期四	2月6日 星期四						
157	Allow 14 days for selection of pile for loading test	14 days	2月7日 星期五	2月20日 星期四						
158	Set up loading test platform for 1st pile testing	12 days	2月21日 星期五	3月3日 星期二						
159	Loading test for 1st pile	4 days	3月4日 星期三	3月7日 星期六						
160	Set up loading test platform for 2nd pile testing	12 days	3月8日 星期日	3月19日 星期四						
161	Loading test for 2nd pile	4 days	3月20日 星期五	3月23日 星期一						
162	Completion of socketted H-pile construction	0 days	3月23日 星期一	3月23日 星期一						
163	Completion of cable bridge	0 days	3月23日 星期一	3月23日 星期一						
164	Completion of section B	0 days	4月30日 星期四	4月30日 星期四						
165	Contract completion	0 days	4月30日 星期四	4月30日 星期四						

Master Programme      Task      Critical Task      Milestone      Summary

**Monthly Waste Flow Table for May 2019**

Project: Lamma Power Station Extension - Civil and Building Works for Unit L10

Contractor: Paul Y. Construction Company, Limited

Record by: Ben Lam

Year of Record: 2016, 2017, 2018 & 2019

MM.YYYY	Actual Quantities of Inert C&D Materials Generated Monthly								Actual Quantities of Non-inert C&D Materials Generated Monthly					
	Excavated Materials			Non-excavated Materials					Metals (steel bar / metal strip) <sup>(1)</sup>	Metals (aluminum can) <sup>(1)</sup>	Paper / cardboard packaging <sup>(1)</sup>	Plastics <sup>(1) &amp; (4)</sup>	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g. Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities						
Jan-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Feb-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Mar-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Apr-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
May-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jun-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Jul-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Aug-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Sep-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Oct-16	-	-	-	-	-	-	-	-	-	-	-	-	-	-
Nov-16	1779.48	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Dec-16	0.00	1.43	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	20.48
Jan-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.20	0.00
Feb-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Mar-17	3160.70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.17	0.00	0.00	0.00	0.00	0.00
Apr-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	65.84	0.00	0.00	0.00	0.00	0.00
May-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	23.41	0.00	0.00	0.00	0.00	0.00
Jun-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jul-17	2988.08	0.00	0.00	0.00	0.00	0.00	0.00	0.00	17.26	0.00	0.00	0.00	0.00	0.00
Aug-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	47.61	0.00	0.00	0.00	0.00	0.00
Sep-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	5.04	0.00	0.00	0.00	0.00	0.00
Oct-17	1963.25	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.20	0.00
Nov-17	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	10.90	0.00	0.00	0.00	0.00	0.00
Dec-17	3011.55	0.00	0.00	0.00	0.00	0.00	0.00	0.00	12.41	0.00	0.00	0.00	0.00	0.00
Jan-18	117.26	0.00	0.00	0.00	0.00	0.00	0.00	0.00	9.81	0.00	0.00	0.00	0.00	151.22
Feb-18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.20	0.00
Mar-18	2434.48	0.00	0.00	0.00	0.00	0.00	0.00	0.00	65.84	0.00	0.00	0.00	0.00	4.94
Apr-18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	24.41	0.00	0.00	0.00	0.00	0.00
May-18	1390.43	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jun-18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	39.35
Jul-18	1655.07	0.00	0.00	0.00	0.00	0.00	0.00	0.00	9.11	0.00	0.00	0.00	0.00	18.35
Aug-18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	22.04	0.00	0.00	0.00	0.00	35.11
Sep-18	823.76	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Oct-18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.75	0.00	0.00	0.00	0.00	2.93
Nov-18	1734.14	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.60	5.09
Dec-18	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	10.64	0.00	0.00	0.00	0.00	1.79
Jan-19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.94	0.00	0.00	0.00	0.00	25.57
Feb-19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Mar-19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Apr-19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
May-19	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.11
Total	21057.60	1.43	0.00	0.00	0.00	0.00	0.00	0.00	282.34	0.00	0.00	0.00	1.20	307.94

Total Inert C&D Waste Materials Generated	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste
21059.03 tonnes	282.34 tonnes	307.94 tonnes	1200 Liters

- Where (A) Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total, 21059.03 tonnes of inert C&D material were generated from the Project, of which 0 tonnes were reused in this and other contracts, and the remaining 21059.03 tonnes were disposed as public fill to Fill Banks / Sorting Facilities.
- (b) Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse. Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill.
- (c) 0 kg of metals, 0 kg of papers/ cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.
- (d) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.

- Notes:
- (1) metal, paper & plastic were collected by recycler
  - (2) The performance target of waste recycling are specified in the Contract.
  - (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
  - (4) Plastics refer to plastic bottles/ containers, plastic/ foam from packaging material.
  - (5) Broken concrete for recycling into aggregates.
  - (6) Disposal of inert waste to public fill or sorting facilities will **NOT** be considered as recycled waste.

**Monthly Waste Flow Table for May 2019**

Project: LAMMA POWER STATION EXTENSION – Unit 10 Complete Erection, Inspection, Testing & Commissioning of Power Block Facilities

Contractor: Taihei Dengyo Kaisha, Ltd.

Record by: Stephen Sin

Year of Record: 2017, 2018, 2019

MM.YYYY	Actual Quantities of Inert C&D Materials Generated Monthly								Actual Quantities of Non-inert C&D Materials Generated Monthly					
	Excavated Materials				Non-excavated Materials				Metals (steel bar / metal strip) <sup>(1)</sup>	Metals (aluminum can) <sup>(1)</sup>	Paper / cardboard packaging <sup>(1)</sup>	Plastics <sup>(1) &amp; (4)</sup>	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g. Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities						
(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in L)	(in '000kg)	
Jan 2017	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Feb 2017	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Mar 2017	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Apr 2017	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
May 2017	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
Jun 2017	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jul 2017	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Aug 2017	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Sep 2017	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Oct 2017	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Nov 2017	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Dec 2017	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jan 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Feb 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Mar 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	14.73
Apr 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	6.09
May 2018	0.00	0.00	0.00	0.00	0.00	0.00	8.43	7.53	0.00	0.00	0.00	0.00	0.00	0.00
Jun 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Jul 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	13.82
Aug 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	60.00	67.37
Sep 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	15.36
Oct 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	91.32
Nov 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	11.35
Dec 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	7.23
Jan 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	20.97
Feb 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	60.00	7.11
Mar 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Apr 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
May 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	9.13
Jun 2019														
Jul 2019														
Aug 2019														
Sep 2019														
Oct 2019														
Nov 2019														
Dec 2019														
Total	0.00	0.00	0.00	0.00	0.00	0.00	8.43	7.53	0.00	0.00	0.00	0.00	120.00	264.48

Total Inert C&D Waste Materials Generated	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste
15.96 tonnes	0.00 tonnes	264.48 tonnes	120.00 Liters

Where (A) Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total, 15.96 tonnes of inert C&D material were generated from the Project, of which 0 tonnes were reused in this and other contracts, and the remaining 15.96 tonnes were disposed in Public Fill and Sorting Facilities.

(b) Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse. Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill.

(c) 0 kg of metals, 0 kg of papers/ cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.

(d) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.

Notes:

- (1) metal, paper & plastic were collected by recycler
- (2) The performance target of waste recycling are specified in the Contract.
- (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
- (4) Plastics refer to plastic bottles/ containers, plastic/ foam from packaging material.
- (5) Broken concrete for recycling into aggregates.
- (6) Disposal of inert waste to public fill or sorting facilities will **NOT** be considered as recycled waste.



## Monthly Waste Flow Table for May 2019

Project: Lamma Power Station Extension - Civil and Building Works for Unit L11

Contractor: Paul Y. Construction Company, Limited

Record by: Ben Lam

Year of Record: 2018 & 2019

MM.YYYY	Actual Quantities of Inert C&D Materials Generated Monthly								Actual Quantities of Non-inert C&D Materials Generated Monthly					
	Excavated Materials			Non-excavated Materials					Metals (steel bar / metal strip) <sup>(1)</sup>	Metals (aluminum can) <sup>(1)</sup>	Paper / cardboard packaging <sup>(1)</sup>	Plastics <sup>(1) &amp; (4)</sup>	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g. Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities						
(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000L)	(in '000kg)	
Jul 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Aug 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Sep 2018	3160.23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Oct 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Nov 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	8.87
Dec 2018	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	10.67
Jan 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Feb 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	4.66	0.00	0.00	0.00	0.60	0.00
Mar 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	12.05	0.00	0.00	0.00	0.00	0.00
Apr 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	19.09
May 2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	3.63	0.00	0.00	0.00	0.00	59.75
Jun 2019														
Jul 2019														
Aug 2019														
Sep 2019														
Oct 2019														
Nov 2019														
Dec 2019														
Total	3160.23	0.00	0.00	0.00	0.00	0.00	0.00	0.00	20.34	0.00	0.00	0.00	0.60	98.38

Total Inert C&D Waste Materials Generated	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste
3160.23 tonnes	20.34 tonnes	98.38 tonnes	600 Liters

- Where (A) Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total, 3160.23 tonnes of inert C&D material were generated from the Project, of which 0 tonnes were reused in this and other contracts, and the remaining 3160.23 tonnes were disposed as public fill to Fill Banks / Sorting Facilities.
- (b) Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse. Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill
- (c) 3630 kg of metals 0 kg of papers/ cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.
- (d) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.

- Notes:
- (1) metal, paper & plastic were collected by recycler
  - (2) The performance target of waste recycling are specified in the Contract.
  - (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
  - (4) Plastics refer to plastic bottles/ containers, plastic/ foam from packaging material.
  - (5) Broken concrete for recycling into aggregates.
  - (6) Disposal of inert waste to public fill or sorting facilities will NOT be considered as recycled waste.

## Monthly Waste Flow Table for May 2019

Project: Foundation Works for Lamma Power Station Extension Unit L12

Contractor: Sunley Engineering & Construction Co Ltd

Record by: Lim Cheng

Year of Record: 2019

MM.YYYY	Actual Quantities of Inert C&D Materials Generated Monthly								Actual Quantities of Non-inert C&D Materials Generated Monthly					
	Excavated Materials			Non-excavated Materials					Metals (steel bar / metal strip) <sup>(1)</sup>	Metals (aluminum can) <sup>(1)</sup>	Paper / cardboard packaging <sup>(1)</sup>	Plastics <sup>(1) &amp; (4)</sup>	Chemical waste (wasted lubricant oil/oil container)	Other, e.g. general refuse
	Disposed in Public Fill	Disposed in Sorting Facilities	Others (e.g. Reused in the Contract / Other Projects)	Broken Concrete or Construction Waste Collected by Recycled Company	Reused in the Contract	Reused in other Projects	Disposed in Public Fill	Disposed in Sorting Facilities						
(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in '000kg)	(in L)	(in '000kg)	
Apr-2019	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
May-2019	7417.96	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Total	7417.96	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

Total Inert C&D Waste Materials Generated	Non-inert C&D Materials		
	C&D Materials Recycled	C&D Waste Disposed of at Landfill	Chemical Waste
7417.96 tonnes	0 tonnes	0.00 tonnes	0L

- Where (A) Inert C&D materials include bricks, concrete, building debris, rubble and excavated spoil. In total, 7417.96 tonnes of inert C&D material were generated from the Project, of which 0 tonnes were reused in this and other contracts, and the remaining 7417.96 tonnes were disposed as public fill to Fill Banks/Sorting Facilities.
- (b) Non-inert C&D materials (construction wastes) include metals, paper / cardboard packaging waste, plastics and other wastes such as general refuse. Metals generated from the Project were grouped into construction wastes as the materials were not disposed of with others at the public fill.
- (c) 0.00 tonnes of metals, 0 kg of papers/ cardboard packing and 0 kg of plastics were sent to recyclers for recycling during the reporting period.
- (d) Construction wastes other than metals, paper/cardboard packaging, plastics and chemicals were disposed of at Landfill.

- Notes:
- (1) metal, paper & plastic were collected by recycler
  - (2) The performance target of waste recycling are specified in the Contract.
  - (3) The waste flow table shall also include C&D materials that are specified in the Contract to be imported for use at the Site.
  - (4) Plastics refer to plastic bottles/ containers, plastic/ foam from packaging material.
  - (5) Broken concrete for recycling into aggregates.
  - (6) Disposal of inert waste to public fill or sorting facilities will **NOT** be considered as recycled waste.
  - (7) Quantity of metal recycled is revised.